



CONTROL PANEL OPERATING MANUAL

**WATER-COOLED SCREW CHILLER FLOODED
MICROTECH III CONTROLLER
D-EOMWC00304-14EN**



Table of Contents

INTRODUCTION.....	3	COMPRESSOR FUNCTIONS.....	32
CONTROLLER OPERATING LIMITS:		CALCULATIONS	32
.....	4	COMPRESSOR CONTROL LOGIC	32
CONTROLLER FEATURES.....	4	COMPRESSOR STATUS	33
GENERAL DESCRIPTION	6	COMPRESSOR CONTROL	33
OPERATION COMMANDS LAYOUT	6	LIQUID INJECTION.....	35
CONTROLLER DESCRIPTION	8	ALARMS AND EVENTS	36
HARDWARE STRUCTURE.....	8	SIGNALING ALARMS	36
SYSTEM ARCHITECTURE	9	CLEARING ALARMS	36
SEQUENCE OF OPERATION.....	11	DESCRIPTION OF ALARMS	36
CONTROLLER OPERATION.....	14	UNIT EVENTS	39
MICROTECH III INPUTS/OUTPUTS.....	14	COMPRESSOR STOP ALARMS	41
EXTENSION I/O COMPRESSOR #1 TO #2	15	COMPRESSOR EVENTS.....	43
I/O EXV #1 TO #2	15	ALARM LOGGING.....	43
EXTENSION I/O UNIT HEAT PUMP	16	USING THE CONTROLLER.....	44
SETPOINTS	16	NAVIGATING.....	45
UNIT FUNCTIONS	19	OPTIONAL REMOTE USER	
CALCULATIONS	19	INTERFACE	48
UNIT ENABLE	20	START-UP AND SHUTDOWN.....	50
UNIT MODE SELECTION	20	TEMPORARY SHUTDOWN.....	50
UNIT CONTROL STATES	21	EXTENDED (SEASONAL) SHUTDOWN ..	51
UNIT STATUS.....	21	FIELD WIRING DIAGRAM.....	53
ICE MODE START DELAY	22	BASIC CONTROL SYSTEM	
PUMP CONTROL	22	DIAGNOSTIC	54
CONDENSER PUMP CONTROL.....	23	CONTROLLER MAINTENANCE ..	56
CONDENSATION CONTROL.....	24	APPENDIX	57
LEAVING WATER TEMPERATURE (LWT)		DEFINITIONS	57
RESET	25		
UNIT CAPACITY CONTROL.....	27		
EXV CONTROL.....	29		
UNIT CAPACITY OVERRIDES	30		



Unit controllers are LONMARK
certified with an optional LONWORKS
communications module

Introduction

This manual provides setup, operating, troubleshooting and maintenance information for the DAIKIN Water Cooled Chillers with Flooded heat exchangers and 1 or 2 screw compressors using Microtech III Controller.

HAZARD IDENTIFICATION INFORMATION

DANGER

Dangers indicate a hazardous situation which will result in death or serious injury if not avoided.

WARNING

Warnings indicate potentially hazardous situations, which can result in property damage, severe personal injury, or death if not avoided.

CAUTION

Cautions indicate potentially hazardous situations, which can result in personal injury or equipment damage if not avoided.

Software Version: This manual covers units with Software Version 1.10 The unit's software version number can be viewed by selecting the "About Chiller" menu item accessible without password. Then, pressing the MENU key will return to the Menu screen.

Minimum BSP Version: 9.20

WARNING

Electric shock hazard: can cause personal injury or equipment damage. This equipment must be properly grounded. Connections to, and service of, the MicroTech III control panel must be performed only by personnel who are knowledgeable in the operation of this equipment .

CAUTION

Static sensitive components. A static discharge while handling electronic circuit boards can cause damage to the components. Discharge any static electrical charge by touching the bare metal inside the control panel before performing any service work. Never unplug any cables, circuit board terminal blocks, or power plugs while power is applied to the panel.

NOTICE

This equipment generates, uses, and can radiate radio frequency energy and, if not installed and used in accordance with this instruction manual, can cause interference to radio communications. Operation of this equipment in a residential area can cause harmful interference, in which case the user will be required to correct the interference at the user's own expense. Daikin disclaims any liability resulting from any interference or for the correction thereof.

Controller Operating Limits:

Operation (IEC 721-3-3):

- Temperature -40...+70 °C
- Restriction LCD -20... +60 °C
- Restriction Process-Bus -25...+70 °C
- Humidity < 90 % r.h (no condensation)
- Air pressure min. 700 hPa, corresponding to max. 3,000 m above sea level

Transport(IEC 721-3-2):

- Temperature -40...+70 °C
- Humidity < 95 % r.h (no condensation)
- Air pressure min. 260 hPa, corresponding to max. 10,000 m above sea level.

Controller Features

Readout of the following temperature and pressure readings:

- Entering and leaving chilled water temperature
- Entering and leaving condenser water temperature
- Liquid Temperature
- Saturated evaporator refrigerant temperature and pressure
- Saturated condenser refrigerant temperature and pressure
- Suction line, and discharge line temperatures – calculated superheat for discharge and suction lines
- Oil pressure

Automatic control of primary and standby chilled water pumps and primary condenser water pump. The control will start one of the chilled water pumps (based on lowest run-hours) when the unit is enabled to run (not necessarily running on a call for cooling) and when the water temperature (entering or leaving) reaches a point of freeze possibility (valid also for condenser water temperatures).

Two levels of security protection against unauthorized changing of setpoints and other control parameters.

Warning and fault diagnostics to inform operators of warning and fault conditions in plain language. All events and alarms are time and date-stamped for identification of when the fault condition occurred.

Fifty previous alarms are available.

Remote input signals for chilled water reset, demand limiting, current limit and unit enable.

Test mode allows the service technician to manually control the controllers' outputs and can be useful for system checkout.

Building Automation System (BAS) communication capability via LonTalk®, Modbus®, or BACnet® standard protocols for all BAS manufacturers.

Pressure transducers for direct reading of system pressures. Preemptive control of low evaporator pressure conditions and high discharge pressure to take corrective action prior to a fault trip.

General Description

The control panel is located on the front of the unit at the compressor end. There are three doors. The control panel is behind to left-hand door. The power panel is behind the middle and right-hand doors.

General Description


The MicroTech III control system consists of a microprocessor-based controller and a number of extension modules, which vary depending on the unit size and conformation. The control system provides the monitoring and control functions required for the controlled, efficient operation of the chiller.



The operator can monitor all critical operating conditions by using the screen located on front of the left-hand door. In addition to providing all normal operating controls, the MicroTech III control system will take corrective action if the chiller is operating outside of its normal design conditions. If a fault condition develops, the controller will shut a compressor, or the entire unit, down and activate an alarm output. .

The system is password protected and only allows access by authorized personnel. Except that some basic information is viewable and alarms can be cleared without a password. No settings can be changed.

Operation Commands Layout

Figure 1, Operation Commands

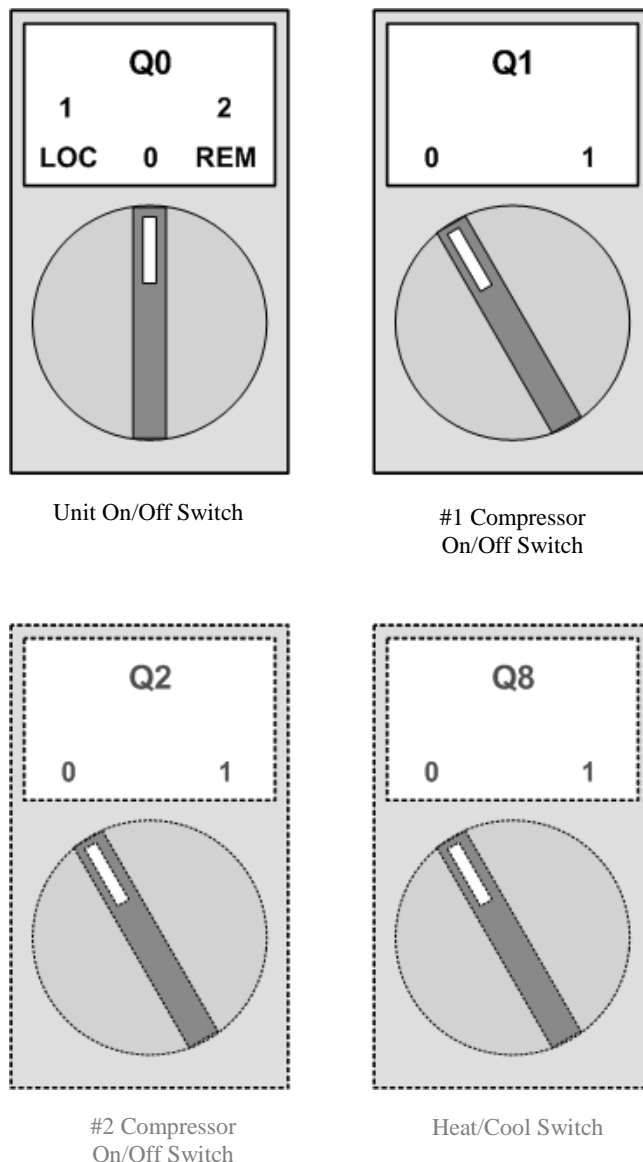

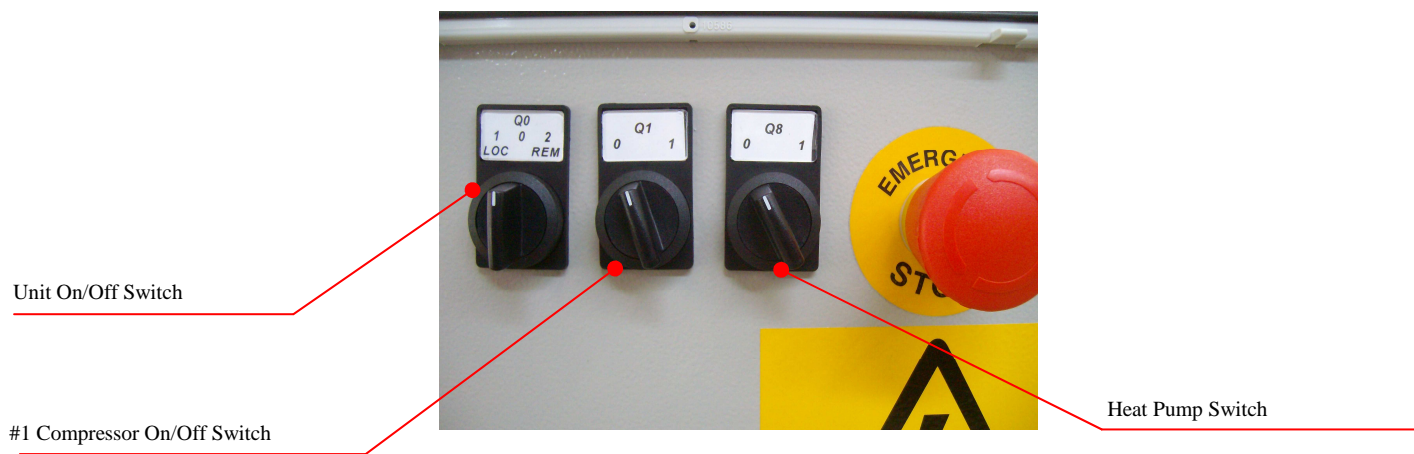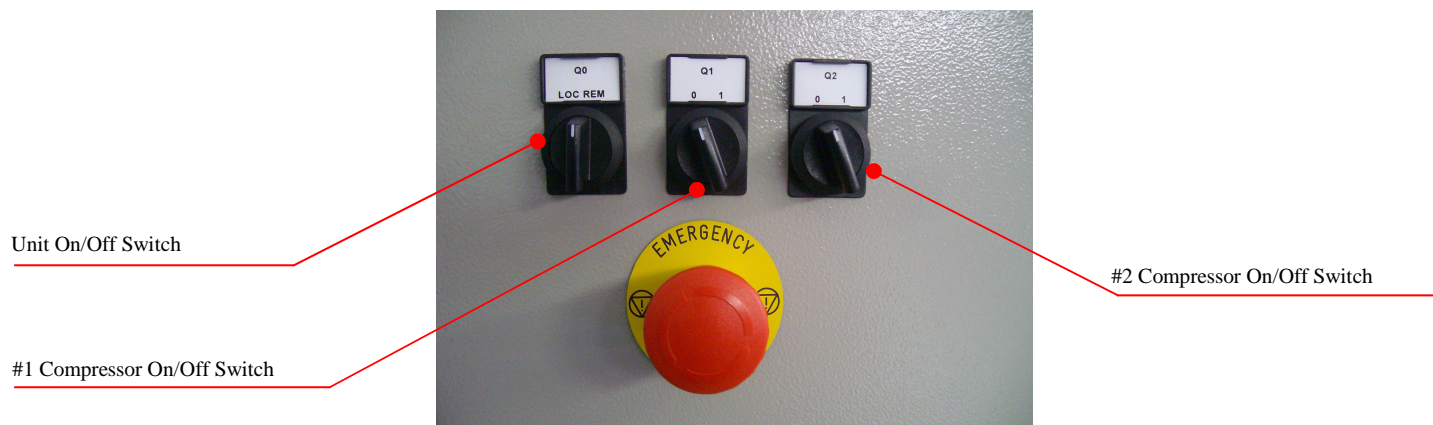

Controller Description

Hardware Structure


The MicroTech III control system for water cooled screw chillers with Flooded heat exchangers consists of a main unit controller with a number of extension I/O modules attached depending on the chiller size and configuration.

Up to two optional BAS communication modules may be included on request.

An optional Remote Operator Interface panel may be included, connected with up to nine units.

The Advanced MicroTech III controllers used on water cooled screw chillers with Flooded heat exchangers are not interchangeable with previous MicroTech II controllers.

Figure 6, hardware structure

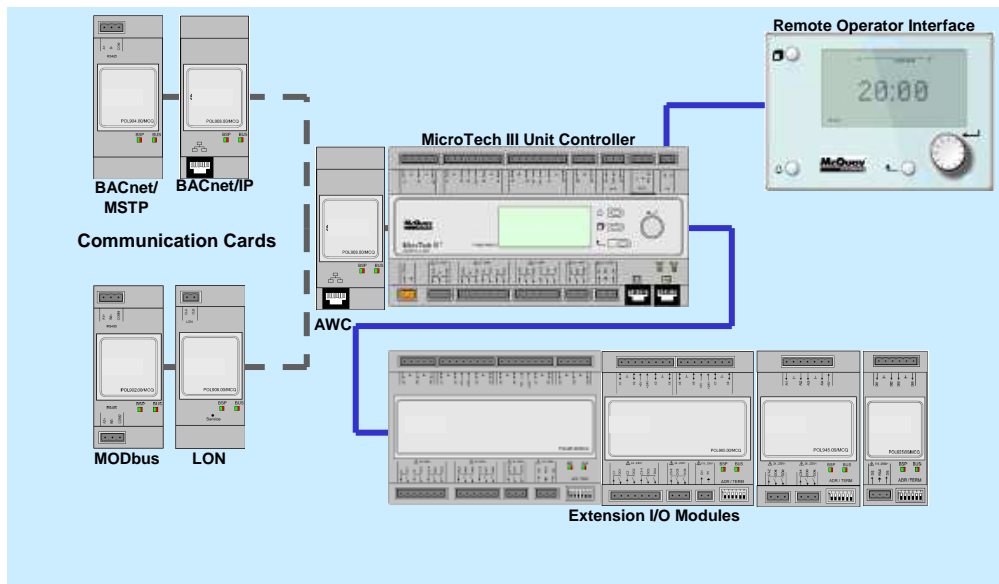


System Architecture

The overall controls architecture uses the following:

- One Microtech III main controller
- I/O extension modules as needed depending on the configuration of the unit
- Optional BAS interface as selected

Figure 2, System Architecture

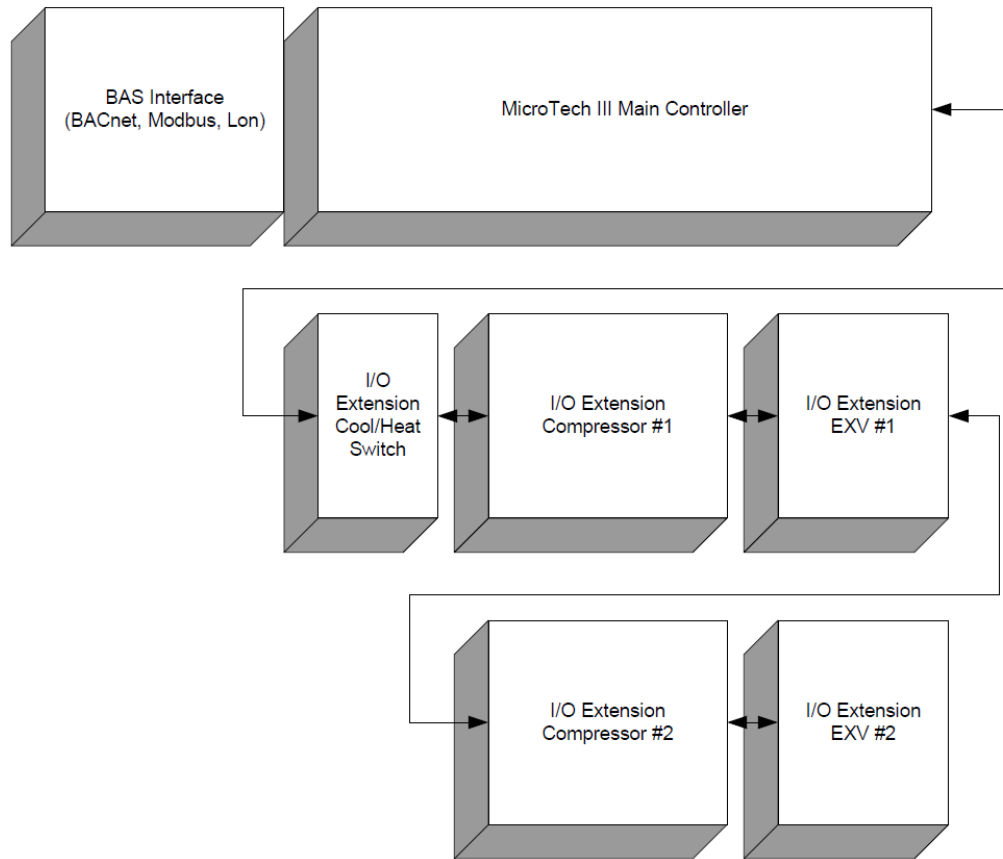

Control network details

Peripheral Bus is used to connect I/O extensions to the main controller.

Controller/ Extension Module	Siemens Part Number	Addresses	Usage
Unit	POL687.70/MCQ	n/a	Used on all configurations
Compressor #1	POL965.00/MCQ	2	
EEXV #1	POL94U.00/MCQ	3	
Comp. #2	POL965.00/MCQ	4	Used when configured for 2
EEXV #2	POL94U.00/MCQ	5	
HP	POL925.00/MCQ	25	Heat Pump Option


Communication modules

Any of the following modules can be connected directly to the left side of the main controller to allow a BAS interface to function.

Module	Siemens Part Number	Usage
BacNet/IP	POL908.00/MCQ	Optional
Lon	POL906.00/MCQ	Optional
Modbus	POL902.00/MCQ	Optional
BACnet/MSTP	POL904.00/MCQ	Optional

Sequence of Operation

Figure 3, Unit Sequence of Operation (see Figure 4 for circuit sequence of operation)

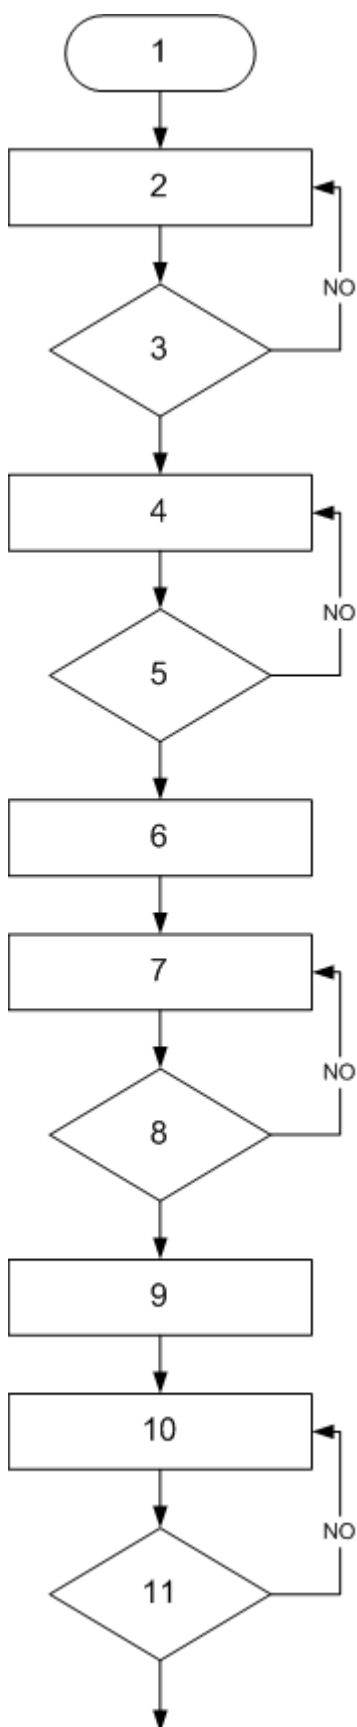

1 to 3: The chiller may be disabled by the unit switch, remote switch, the keypad enable setting or the BAS network. In addition, the chiller will be disabled if all the compressors are disabled or in case of unit alarm. If the chiller is disabled the unit status will reflect this and also show why it is disabled.

4: If the chiller is enabled, then the unit will be in Auto state and the Evaporator water pump output will be activated.

5: The chiller will then wait for the flow switch to close. Unit status will be Auto:Wait for flow

6: After establishing flow, the chiller will wait some time to allow the chilled water loop to recirculate for an accurate reading of the leaving water temperature.


7: After establishing flow and chilled water has recirculated, the Condenser pump output will be activated.

8: The chiller will then wait for the flow switch to close.

9: After establishing the flow, the chiller will wait for some time to allow the Condenser water loop to recirculate.

10 to 11: The chiller is now ready to start if enough load is present. If the LWT is not higher than the Active Setpoint plus the Start Up Delta T, the unit status will be Auto: Wait for Load.

If the LWT is higher than the Active Setpoint plus the Start Up Delta T, the unit status will be Auto. A compressor can start at this time.

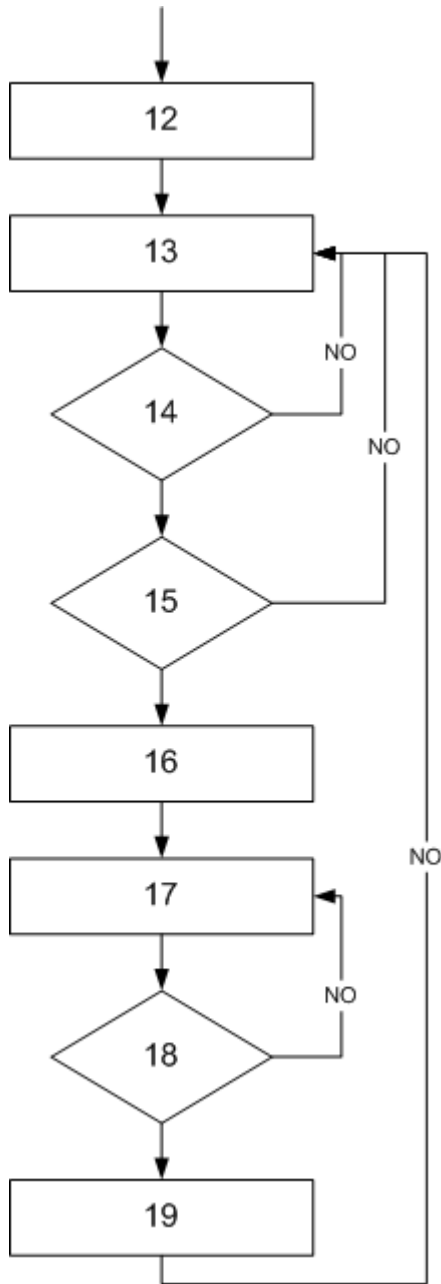

12: The first compressor to start is generally the available compressor with the least number of starts. This compressor will go through its start sequence at this point.

13: the first compressor will be loaded and unloaded as needed in an attempt to satisfy the load by controlling the LWT to the Active Setpoint.

14: if a single compressor is not enough to satisfy the load, an additional compressor will need to be started. An additional compressor will be started when the running compressor is loaded to a specific capacity and the LWT is higher than the Active Setpoint plus the Stage Up Delta T.

15: a minimum time must pass between the starting of compressors. The time remaining can be viewed on the HMI if the minimum password level is active.


16: The second compressor will go through the its start sequence at this point.

17: all the running compressors will now be loaded/unloaded as needed to satisfy the load. When possible they will load balance so that running compressors are providing nearly equal capacity.

18: As the load drops off, the compressors will unload accordingly. If the LWT drops below the Active Setpoint minus the Stage Down Delta T, one compressor will shut off. If the running compressors are unloaded below a minimum value, this can also result in a compressor shutting off.

19: The next circuit off is generally the one with the most run hours.

Figure 4, Circuit Sequence of Operation

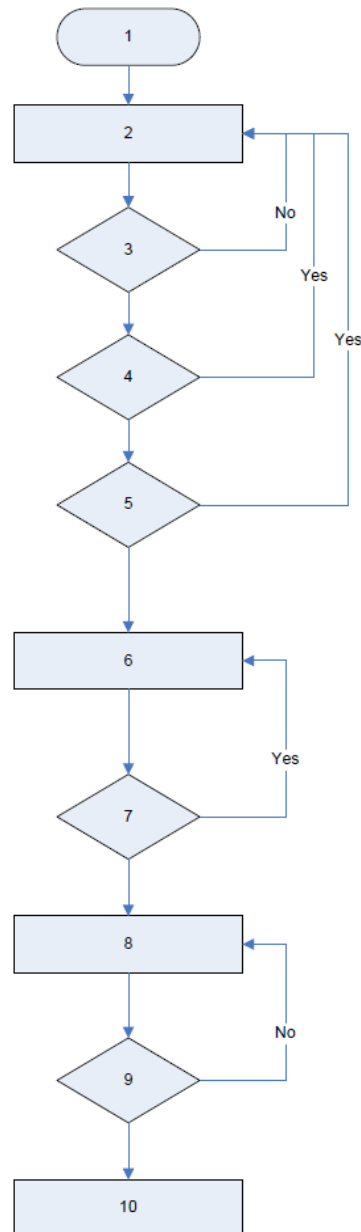

Sequence of Operation Compressor

1: Unit is powered and enabled to Run

2: The compressor can be disabled at the unit start.

3: The compressor must be enabled before it can run. When the compressor is Off the status will be Off: Compressor Switch. If the compressor has an active stop alarm then the status will be Off: Comp Alarm.

4: A minimum time must pass between the previous start of a compressor and the next start. If this timer has not passed a cycle timer will be active and the compressor status will be Off: Cycle Timer.

5: If the compressor is not ready due to the refrigerant in oil sump the compressor will not start. The compressor status will be Off: Oil Heating.

6 and 7: If the compressor is ready to start when needed the compressor status will be Off: Ready. The control wait for a start command to run the compressor.

8 and 9: When the compressor begin to run the compressor status will be Run: Normal. It will continue to run until a stop command will be generated.

10: When the compressor will be commanded to stop it will download completely and then stop.

Controller Operation

MicroTech III Inputs/Outputs

The chiller may be equipped with one up to three compressors.

Analog Inputs

#	Description	Signal Source	Expected Range
AI1	Evaporator Entering Water Temp	NTC Thermister (10K@25°C)	-50°C – 120°C
AI2	Evaporator Leaving Water Temp	NTC Thermister (10K@25°C)	-50°C – 120°C
AI3	Condenser Entering Water Temp	NTC Thermister (10K@25°C)	-50°C – 120°C
X1	Condenser Leaving Water Temp	NTC Thermister (10K@25°C)	-50°C – 120°C
X4	LWT Reset	4-20 mA Current	1 to 23 mA
X7	Demand Limit	4-20 mA Current	1 to 23 mA
X8	Unit Current	4-20 mA Current	1 to 23 mA

Analog Outputs

#	Description	Output Signal	Range
X5	Condenser Pump VFD	0-10VDC	0 to 100% (1000 steps resolution)
X6	Condenser Bypass Valve	0-10VDC	0 to 100% (1000 steps resolution)

Digital Inputs

#	Description	Signal Off	Signal On
DI1	Unit PVM	Fault	No Fault
DI2	Evaporator Flow Switch	No Flow	Flow
DI3	Double Set Point/ Mode Switch	Cool mode	Ice mode
DI4	External Alarm	Remote off	Remote on
DI5	Unit Switch	Unit off	Unit on
DI6	Emergency Stop	Unit off/rapid stop	Unit on
X2	Current Limit Enable	Disabled	Enabled
X3	Condenser Flow Switch	No Flow	Flow

Digital Outputs

#	Description	Output OFF	Output ON
DO1	Evaporator Water Pump #1	Pump Off	Pump On
DO2	Unit Alarm	Alarm not Active	Alarm Active (Flashing= circuit alarm)
DO3	Cooling Tower Out 1	Fan Off	Fan On
DO4	Cooling Tower Out 2	Fan Off	Fan On
DO5	Cooling Tower Out 3	Fan Off	Fan On
DO6	Cooling Tower Out 4	Fan Off	Fan On
DO7	Oil Equalization Solenoid Valve	Solenoid Closed	Solenoid Open
DO9	Condenser Water Pump	Pump Off	Pump On
DO10	Evaporator Water Pump #2	Pump Off	Pump On

Extension I/O Compressor #1 to #2

Analog Inputs

#	Description	Signal Source	Expected Range
X1	Discharge Temperature	NTC Thermister (10K@25°C)	-50°C – 120°C
X2	Slide Position Sensor	LVDT Transducer	4 to 20 mA
X3	Oil Pressure	Ratiometric (0,5-4,5 Vdc)	0 to 5 Vdc
X4	Condenser Pressure (*)	Ratiometric (0,5-4,5 Vdc)	0 to 5 Vdc
X7	Motor Protection	PTC Thermistor	n/a
X8	Liquid Temperature	NTC Thermister (10K@25°C)	-50°C – 120°C

(*) Only on Compressor Control module #1

Analog Outputs

#	Description	Output Signal	Range
Not Needed			

Digital Inputs

#	Description	Signal Off	Signal On
X5	Circuit Switch	Circuit Off	Circuit On
X6	Starter Fault	Fault	No fault
DI1	High Pressure Switch	Fault	No fault

Digital Outputs

#	Description	Output Off	Output On
DO1	Start Compressor	Compressor Off	Compressor On
DO2	Compressor Alarm	No Alarm	Alarm
DO3	Oil Heater Resistance	Oil Heater Off	Oil Heater On
DO4	Liquid Injection	Liquid Injection Off	Liquid Injection On
DO5	Load Compressor	Load Off	Load On
DO6	Unload Compressor	Unload Off	Unload On

I/O EXV #1 to #2

Analog Inputs

#	Description	Signal Source	Expected Range
X1	Evaporator Pressure (*)	Ratiometric (0,5-4,5 Vdc)	0 to 5 Vdc
X2	Suction Temperature	NTC Thermister 10K@25°C)	-50°C – 120°C
X3			

(*) Only on driver #1

Analog Outputs

#	Description	Output Signal	Range
Not Needed			

Digital Inputs

#	Description	Signal Off	Signal On
DI1	Low Press Switch	No Fault	Fault

Digital Outputs

#	Description	Output Off	Output On

Stepper Motor Output

#	Description
M1+	EXV Stepper Coil 1
M1-	
M2+	EXV Stepper Coil 2
M2-	

Extension I/O Unit Heat Pump

Digital Inputs

#	Description	Signal Off	Signal On
DI1	Cool Heat Switch	Cooling Mode	Heating Mode

Setpoints

The following parameters are remembered during power off, are factory set to the **Default** value, and can be adjusted to any value in the **Range** column.

Read and write access to these set points is determined by the Global HMI (Human Machine Interface) Standard Specification.

Table 1, Setpoint Value and Range

Description	Default		Range
Unit	Ft/Lb	SI	
Manufacturing Location	Not Selected		Not Selected, Europe, USA
Unit Enable	Disabled		Disabled, Enabled
Control source	Local		Local, Network
Available Modes	Cool		COOL COOL/w GLYCOL COOL/ICE w GLYCOL ICE w/GLYCOL HEAT/COOL HEAT/COOL w GLYCOL HEAT/ICE w GLYCOL TEST
Cool LWT 1	7 °C		See section 0
Cool LWT 2	7 °C		See section 0
Heat LWT 1	45 °C		40 to 60°C
Heat LWT 2	45 °C		40 to 60°C
Ice LWT	-4 °C		-8 to 4 °C
Startup Delta T	2,7 °C		0 to 5 °C
Shut Down Delta T	1,5 °C		0 to 1,7 °C
Stage Up Delta T (between compressors)	1 °C		0 to 1,7 °C
Stage Down Delta T (between compressors)	0,5 °C		0 to 1,7 °C
Max Pulldown	1,7 °C/min		0,3 to 2,7 °C/min
Max Pullup	1,7 °C/min		0,3 to 2,7 °C/min
Evap Recirc Timer	30		0 to 300 seconds
Evap Control	#1 Only		#1 Only, #2 Only, Auto, #1 Primary, #2 Primary
LWT Reset Type	None		None, 4-20mA, Return, OAT
Max Reset	5 °C		0 to 10 °C
Start Reset Delta T	5 °C		0 to 10 °C
Soft Load	Disable		Disable, Enable
Starting Capacity Limit	40%		20-100%
Soft Load Ramp	20 min		1-60 minutes
Demand Limit	Disable		Disable, Enable
Flex Current Limit	Disable		Disable, Enable
Current @ 20mA	800 Amp		0 to 2000 Amp = 4 to 20 mA
Current limit Set Point	800 Amp		0 to 2000 Amp
# of Compressors	2		1-2

Description	Default		Range
Unit	Ft/Lb	SI	
Ice Cycle Delay	12		1-23 hours
Condenser Water Temp Setpoint	35 °C		69,8 to 140 °F / 21 to 60 °C
Condensation Control value	Cond In		Cond In, Cond Out
Condensation Analog Output type	None		None, Vfd, Bypass Valve
Tower 1 Setpoint	35 °C		21 to 60 °C
Tower 2 Setpoint	37 °C		21 to 60 °C
Tower 3 Setpoint	39 °C		21 to 60 °C
Tower 4 Setpoint	41 °C		21 to 60 °C
Tower 1 Differential	1.5 °C		0,1 to 10 dK
Tower 2 Differential	1.5 °C		0,1 to 10 dK
Tower 3 Differential	1.5 °C		0,1 to 10 dK
Tower 4 Differential	1.5 °C		0,1 to 10 dK
Vfd Min Speed	10%		0 to 100%
Vfd Max Speed	100%		0 to 100%
Byp valve Min Opening	0%		0 to100%
Byp valve Max Opening	95%		0 to100%
Vfd/ Byp valve PID prop gain (kp)	10.0		0 to 50
Vfd/ Byp valve PID deriv time (Td)	1.0 s		0 to 180s
Vfd/ Byp valve PID integ time (Ti)	600.0 s		0 to 600s
Clear Ice Delay	No		No, Yes
Evap LWT sensor offset	0°F	0°C	-5.0 to 5.0°C / -9.0 to 9.0°F
Evap EWT sensor offset	0°F	0°C	-5.0 to 5.0°C / -9.0 to 9.0°F
Start-start timer	10 min		6-60 minutes
Compressor – Global	Ft/Lb	SI	
Stop-start timer	5 min		3-20 minutes
Pumpdown Pressure	200 kPa		70 to 280 kPa
Pumpdown Time Limit	120 sec		0 to 180 sec
Light Load Stg Dn Point	50%		20 to 50%
Load Stg Up Point	50%		50 to 100%
Stage Up Delay	5 min		0 to 60 min
Stage Down Delay	3 min		3 to 30 min
Stage Delay Clear	No		No, Yes
Max # Comps Running	2		1-3
Sequence # Cir 1	1		1-4
Sequence # Cir 2	1		1-4
Sequence # Cir 3	1		1-4
Liquid Injection Activation	85°C		75 to 90°C
Low Evap Pressure-Unload	160 kPa		See section 0
Low Evap Pressure-Hold	180 kPa		See section 0
High Oil Press Delay	30 sec		10-180 sec
High Oil Press Differential	250 kPa		0 to 415 kPa
Low Oil Level Delay	120 sec		10 to 180 sec
High Discharge Temperat.	110 °C		65 to 110 °C
Low Pressure Ratio Delay	90 sec		30-300 sec
Start Time Limit	60 sec		20 to 180 sec
Evaporator Water Freeze	2,2 °C		See section 0
Evaporator Flow Proof	15 sec		5 to 15 sec
Evap Recirculate Timeout	3 min		1 to 10 min

The following set points exist individually for each circuit:

Description	Default		Range
	Ft/Lb	SI	
Circuit mode	Enable		Disable, Enable, Test
Capacity Control	Auto		Auto, Manual
Capacity	0%		0 to 100%
Clear Cycle Timers	Off		Off, On
EXV control	Auto		Auto, manual
EXV position	See note 2 below table		0% to 100%
Service Pumpdown	Off		Off, On
Evap pressure offset	0kPa		-100 to 100 kPa
Cond pressure offset	0kPa		-100 to 100 kPa
Oil pressure offset	0kPa		-100 to 100 kPa
Suction temp offset	0°C		-5.0 to 5.0 deg
Discharge temp offset	0°C		-5.0 to 5.0 deg

Auto Adjusted Ranges

Some settings have different ranges of adjustment based on other settings.

Cool LWT 1 and Cool LWT 2

Available Mode Selection	Range SI
Without Glycol	4 to 15 °C
With Glycol	-4 to 15 °C

Evaporator Water Freeze

Available Mode Selection	Range SI
Without Glycol	2 to 6 °C
With Glycol	-18 to 6 °C

Low Evaporator Pressure - Hold

Available Mode Selection	Range SI
Without Glycol	170 to 310 kPa
With Glycol	0 to 310 kPa

Low Evaporator Pressure - Unload

Available Mode Selection	Range SI
Without Glycol	170 to 250 kPa
With Glycol	0 to 410 kPa

Preliminary Operations

Due to the complexity of the regulating algorithms it's required to proceed with an accurate sensors calibration. The calibration is done by factory and prior to any modification to the control system (controller replacement, software upgrades) it's required to take note of these corrections and restore them in the controller before starting up the machine.

The calibration can also be done by trained service technicians equipped with adequate instrumentation.

Particular care must be taken when calibrating Evaporator Pressure transducer, Suction Temperature sensors and Slide Position indicators.

If one of this sensors/transducers has to be replaced its calibration has to be done again before the machine can be started again.

Unit Functions

Calculations

LWT Slope

LWT slope is calculated such that the slope represents the change in LWT over a time frame of one minute with at least five samples per minute for both evaporator and condenser.

Pulldown Rate

The slope value calculated above will be a negative value as the water temperature is dropping. For use in some control functions, the negative slope is converted to a positive value by multiplying by -1 .

Refrigerant Saturated Temperature

Refrigerant saturated temperature is calculated from the pressure sensor readings for each circuit. A function provides the converted value of temperature to match values published data for R134a

-within 0.1 C for pressure inputs from 0 kPa to 2070kPa,

-within 0.2 C for pressure inputs from -80 kPa to 0 kPa.

Evaporator Approach

The evaporator approach is calculated for the single refrigerant circuit. The equation is as follows:

$$\text{Evaporator Approach} = \text{LWT} - \text{Evaporator Saturated Temperature}$$

Condenser Approach

The condenser approach is calculated for the single refrigerant circuit. The equation is as follows:

$$\text{Condenser Approach} = \text{LWT} - \text{Condenser Saturated Temperature}$$

Maximum Saturated Condenser Temperature

The maximum saturated condenser temperature calculation is modeled after the compressor operational envelope. Its value depends on the slide type used in the compressor and is equal to the following:

HSA (slide 3.0): 69.0°C

HSW (slide 2.2): 58.0°C

High Saturated Condenser – Hold Value

High Cond Hold Value depends on the slide type used in the compressor and is equal to the following:

HSA (slide 3.0): 68.0°C

HSW (slide 2.2): 55.0°C

High Saturated Condenser – Unload Value

High Cond Unload Value depends on the slide type used in the compressor and is equal to the following:

HSA (slide 3.0): 68.5°C

HSW (slide 2.2): 56.0°C

Pressure Ratio

The pressure ratio is calculated as follows:

$$\text{PR} = (\text{Condenser Pressure} + 100\text{kPa}) / (\text{Evaporator Pressure} + 100\text{kPa})$$

SubCooling

The SubCooling is calculated as follows:

$$\text{SubCooling} = \text{Condenser Saturated Temperature} - \text{Liquid Temperature}$$

Unit Enable

Enabling and disabling the chiller is accomplished using set points and inputs to the chiller. The local/remote switch input, and Unit Enable Set Point all are required to be on for the unit to be enabled when the control source is set to local. The same is true if the control source is set to network, with the additional requirement that the BAS request must be on.

Unit is enabled according to the following table.

NOTE: An x indicates that the value is ignored.

Local Remote Switch	Control Source Set Point	Unit Enable Set Point	BAS Request	Unit Enable
Off	x	x	x	Off
x	x	Off	x	Off
x	x	x	x	Off
On	Local	On	x	ON
x	Network	x	Off	Off
On	Network	On	On	ON

All of the methods for disabling the chiller, discussed in this section, will cause a normal shutdown (pumpdown) of any running circuits.

When the controller is powered up, the Unit Enable Set Point will be initialized to 'off' if the Unit Status After Power Failure Set Point is set to 'off'.

Unit Mode Selection

The operating mode of the unit is determined by setpoints and inputs to the chiller. The Available Modes Set Point determines what modes of operation can be used. This setpoint also determines whether the unit is configured for glycol use. The Control Source Set Point determines where a command to change modes will come from. A digital input switches between cool mode and ice mode if they are available and the control source is set to local. The BAS mode request switches between cool mode and ice mode if they are both available and the control source is set to network.

The Available Modes Set Point must only be changed when the unit switch is off. This is to avoid changing modes of operation inadvertently while the chiller is running.

Unit Mode is set according to the following table.

NOTE: An "x" indicates that the value is ignored.

Control Source Set Point	Mode Input	HP Switch	BAS Request	Available Modes Set Point	Unit Mode
x	x	x	x	Cool	Cool
x	x	x	x	Cool w/Glycol	Cool
Local	Off	x	x	Cool/Ice w/Glycol	Cool
Local	On	x	x	Cool/Ice w/Glycol	Ice
Network	x	x	Cool	Cool/Ice w/Glycol	Cool
Network	x	x	Ice	Cool/Ice w/Glycol	Ice
x	x	x	x	Ice w/Glycol	Ice
Local	x	Off	x	Cool/Heat	Cool
Local	x	On	x	Cool/Heat	Heat
Network	x	x	Cool	Cool/Heat	Cool
Network	x	x	Heat	Cool/Heat	Heat
Local	Off	Off	x	Cool/Ice w/Glycol/Heat	Cool
Local	On	Off	x	Cool/Ice w/Glycol/Heat	Ice
Local	x	On	x	Cool w/Glycol/Heat	Cool
Local	x	On	x	Cool w/Glycol/Heat	Heat
Network	x	x	Cool	Cool/Ice w/Glycol/Heat	Cool
Network	x	x	Ice	Cool/Ice w/Glycol/Heat	Ice

				Heat	
Network	x	x	Heat	Cool/Ice w/Glycol/ Heat	Heat
x	x		x	Test	Test

Glycol Configuration

If the Available Modes Set Point is set to an option w/Glycol, then glycol operation is enabled for the unit. Glycol operation must be disabled only when the Available Modes Set Point is set to Cool.

Unit Control States

The unit will always be in one of three states:

- Off – Unit is not enabled to run.
- Auto – Unit is enabled to run.
- Pumpdown – Unit is doing a normal shutdown.

The unit will be in the Off state if any of the following are true:

- A manual reset unit alarm is active
- All compressors are unavailable to start (cannot start even after any cycle timers have expired)
- The unit mode is ice, all circuits are off, and the ice mode delay is active

The unit will be in the Auto state if any of the following are true:

- Unit enabled based on settings and switches
- If unit mode is ice, the ice timer has expired
- No manual reset unit alarms are active
- At least one compressor is enabled and available to start

The unit will be in Pumpdown until all running compressors finish pumping down if any of the following are true:

- Unit is disabled via settings and/or inputs in section 0

Unit Status

The displayed unit status is determined by the conditions in the following table:

Enum	Status	Conditions
0	Auto	Unit State = Auto
1	Off Loc/Rem	Unit State = Off and Unit Switch = Disable
2	Unit Alarm	Unit State = Off and Unit Alarm active
3	Off Ice mode timer	Unit State = Off, Unit Mode = Ice, and Ice Delay = Active
4	Off All compr disable	Unit State = Off and All compressors are unavailable
5	Off Keypad disable	Unit State = Off and Unit Enable Set Point = Disable
6	Off Bas disable	Unit State = Off, Control Source = Network, and BAS Enable = false
7	Test mode	Unit State = Off and Unit Mode = Test
8	Auto Max Pull Dn	
9	Unit Cap Limit	Unit State = Auto, unit capacity limit has been met or exceeded
10	Auto Current Limit	Unit State = Auto, unit current limit has been met or exceeded
11	Cfg chg, rst ctrl	Manufacturing location has been changed reboot required
12	Wait for load	Unit State = Auto, no circuits running, and LWT is less than the active set point + startup delta
13	Water recirc	Unit State = Auto and Evaporator State = Start
14	Wait for flow	Unit State = Auto, Evaporator State = Start, and Flow Switch is open
15	Pumpdown	Unit State = Pumpdown

16	Off Mfg Loc not set	Manufacturing Location
17	Auto LP Hold	Unit State = Auto, High Pressure Hold limit had been exceeded
18	Auto LP Unload	Unit State = Auto, High Pressure Unload limit had been exceeded
19	Auto HP hold	Unit State = Auto, High Pressure Hold limit had been exceeded
	Auto HP Unload	Unit State = Auto, High Pressure Unload limit had been exceeded

Ice Mode Start Delay

An adjustable start-to-start ice delay timer will limit the frequency with which the chiller may start in Ice mode. The timer starts when the first compressor starts while the unit is in ice mode. While this timer is active, the chiller cannot restart in Ice mode. The time delay is user adjustable.

The ice delay timer may be manually cleared to force a restart in ice mode. A set point specifically for clearing the ice mode delay is available. In addition, cycling the power to the controller will clear the ice delay timer.

Evaporator Pump Control

Three pump control states for control of the evaporator pumps:

- Off - No pump on.
- Start – Pump is on, water loop is being recirculated.
- Run – Pump is on, water loop has been recirculated.

The control state is Off when all of the following are true:

- Unit state is Off
- LWT is higher than the Evap Freeze set point or LWT sensor fault is active
- EWT is higher than the Evap Freeze set point or EWT sensor fault is active

The control state is Start when any of the following are true:

- The unit state is auto
- LWT is less than the Evap Freeze set point minus 0.6 °C and LWT sensor fault isn't active
- EWT is less than the Evap Freeze set point minus 0.6 °C and EWT sensor fault isn't active

The control state is Run when the flow switch input has been closed for a time greater than the Evaporator Recirculate set point.

Pump Selection

The pump output used is determined by the Evap Pump Control set point. This setting allows the following configurations:

- #1 only – Pump 1 will always be used
- #2 only – Pump 2 will always be used
- Auto – The primary pump is the one with the least run hours, the other is used as a backup
- #1 Primary – Pump 1 is used normally, with pump 2 as a backup
- #2 Primary – Pump 2 is used normally, with pump 1 as a backup

Primary/Standby Pump Staging

The pump designated as primary will start first. If the evaporator state is start for a time greater than the recirculate timeout set point and there is no flow, then the primary pump will shut off and the standby pump will start. When the evaporator is in the run state, if flow is lost for more than half of the flow proof set point value, the primary pump will shut off and the standby pump will start. Once the standby pump is started, the flow loss alarm logic will apply if flow cannot be established in the evaporator start state, or if flow is lost in the evaporator run state.

Auto Control

If auto pump control is selected, the primary/standby logic above is still used. When the evaporator is not in the run state, the run hours of the pumps will be compared. The pump with the least hours will be designated as the primary at this time.

Condenser Pump Control

There are three condenser pump control states for control of the condenser pump:

- Off
- Start – Pump is on, water loop is being recirculated
- Run – Pump is on, water loop has been recirculated

The control state is Off when any of the following are true:

- Unit state is Off
- LWT is higher of Evap Freeze set point or LWT sensor fault is active
- EWT is higher of Evap Freeze set point or EWT sensor fault is active

The control state is Start when any of the following are true:

- The unit state is auto
- LWT is lower than (Evap Freeze set point - 0.6 °C) and LWT sensor fault is not active or EWT is lower than (Evap Freeze set point – 0.6 °C) and EWT sensor fault is not active.

The control state is Run when the flow switch input has been closed for a time greater than the loop Recirculate set point.

Condensation Control

Three condensation control modes are available:

- Cond In – the condensation control measure is the condenser entering water temperature
- Cond Out - the condensation control measure is the condenser leaving water temperature

The Condenser control mode is determined by the Condensation Control Value set point.


Within these control modes, the application manages the outputs for the control of condensation devices:

- n.4 on/off signals for cooling tower, always available
- n.1 modulating 0-10V signal, whose availability is determined by the Condensation Analog Output type set point.

Cond In/Cond Out condensation control

If the Condensation Control Value Set Point is set to Cond In or Cond Out options, then Tower fan #1..4 control is enabled for the unit.

According to Tower fan #1..4 set point and differential default values listed in the Unit Set Points table, the following graph summarizes the activation and deactivation conditions for Towers fan.

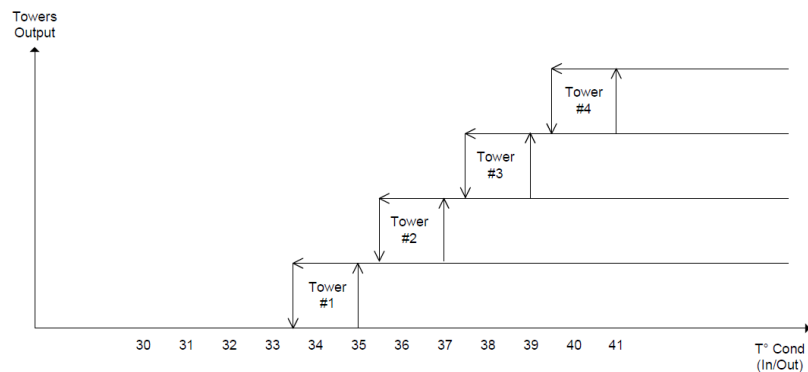

The Tower fan # (# = 1..4) control states are:

- Off
- On

The Tower fan # control state is Off when any of the following are true:


- Unit state is Off
- Tower fan # state is Off and EWT (Cond In) or LWT (Cond Out) is lower than Tower fan # Set point
- Tower fan # state is On and EWT (Cond In) or LWT (Cond Out) is lower than Tower fan # Set point – Tower fan # Diff.

The Tower fan # control state is On when all of the following are true:

- The unit state is auto
- EWT (Cond In) or LWT (Cond Out) is equal or higher than Tower fan # Set point

If the Condensation Control Value Set Point is set to Cond In or Cond Out options and Cond Aout type Set Point is set to Vfd or Byp Valve options, a 0-10V signal is also enabled for the unit to regulate a modulating condensation device by mean of a PID controller.

According to Vfd/Byp Valve default values listed in the Unit Set Points table, the following graph is an example of the modulating signal behavior in case of a control supposed to be purely proportional.

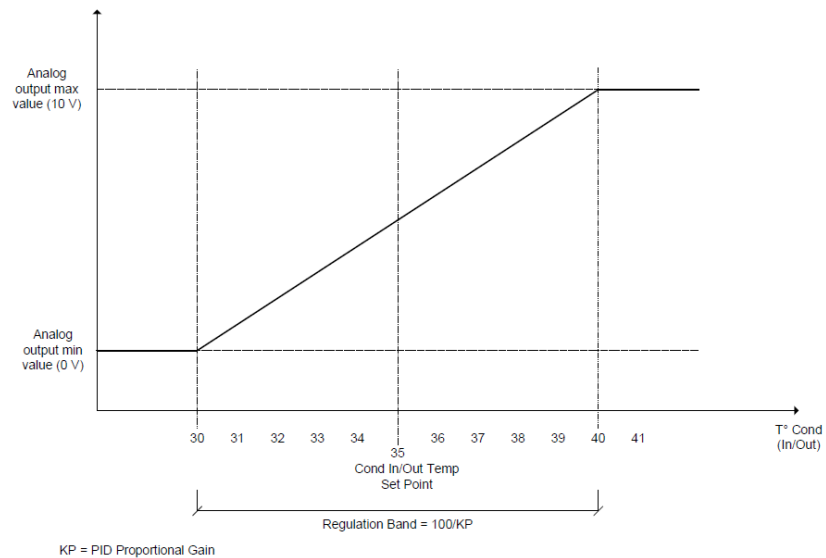

In this case, the analog output varies across the regulation band calculated as Condenser Water Temp Set Point $\pm 100/kp$, where kp is the control proportional gain, and centered on the Condenser Water Temp Set Point.

Vfd regulation is always intended to control a cooling tower fan.

This control will act differently in heat mode. In this case the two analog outputs will always be at maximum.

Leaving Water Temperature (LWT) Reset

LWT Target

The LWT Target varies based on settings and inputs and is selected as follows:

Control Source Set Point	Mode Input	HP Switch	BAS Request	Available Modes Set Point	Base LWT Target
Local	OFF	OFF	X	COOL	Cool Set Point 1
Local	ON	OFF	X	COOL	Cool Set Point 2
Network	X	OFF	COOL	COOL	BAS Cool Set Point
Local	OFF	OFF	X	COOL w/Glycol	Cool Set Point 1
Local	ON	OFF	X	COOL w/Glycol	Cool Set Point 2
Network	X	OFF	X	COOL w/Glycol	BAS Cool Set Point
Local	OFF	OFF	x	COOL/ICE w/Glycol	Cool Set Point 1
Local	ON	OFF	x	COOL/ICE w/Glycol	Ice Set Point
Network	x	OFF	COOL	COOL/ICE w/Glycol	BAS Cool Set Point
Network	x	OFF	ICE	COOL/ICE w/Glycol	BAS Ice Set Point
Local	x	OFF	x	ICE w/Glycol	Ice Set Point
Network	x	OFF	x	ICE w/Glycol	BAS Ice Set Point
Local	OFF	ON	X	HEAT	Heat Set Point 1
Local	ON	ON	X	HEAT	Heat Set Point 2
Network	X	x	HEAT	HEAT	BAS Heat Set Point

Leaving Water Temperature (LWT) Reset

The base LWT target may be reset if the unit is in Cool or Heat mode and it is configured for a reset. The type of reset to be used is determined by the LWT Reset Type set point.

When the active reset increases, the Active LWT Target is changed at a rate of **0.05 °C (0.1°F)** every 10 seconds. When the active reset decreases, the Active LWT Target is changed all at once.


After resets are applied, the LWT target can never exceed a value of **15°C (60°F)**.

Reset Type – None

The Active Leaving Water variable is set equal to the current LWT set point.

Reset Type – Return

The Active Leaving Water variable is adjusted by the return water temperature.

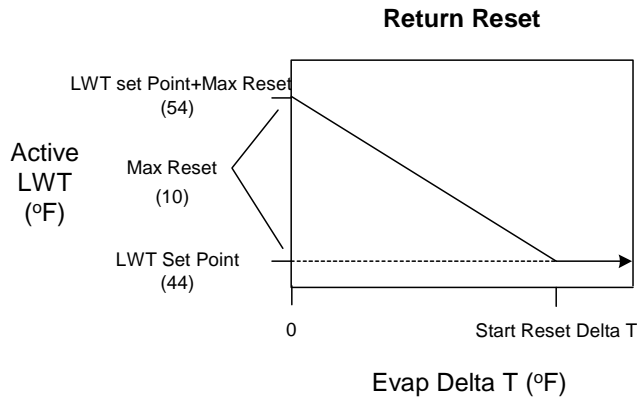

The active set point is reset using the following parameters:

1. Cool LWT set point
2. Max Reset set point
3. Start Reset Delta T set point
4. Evap Delta T

Reset varies from 0 to Max Reset set point as the Evaporator EWT – LWT (Evap delta t) varies from the Start Reset Delta T set-point to 0.


4-20 mA External Signal Reset

The Active Leaving Water variable is adjusted by the 4 to 20 mA reset analog input.

Parameters used:

1. Cool LWT set point
2. Max Reset set point
3. LWT Reset signal

Reset is 0 if the reset signal is less than or equal to 4 mA. Reset is equal to the Max Reset Delta T set point if the reset signal equals or exceeds 20 mA. The amount of reset will vary linearly between these extremes if the reset signal is between 4 mA and 20 mA. An example of the operation of 4-20 reset in Cool mode follows.

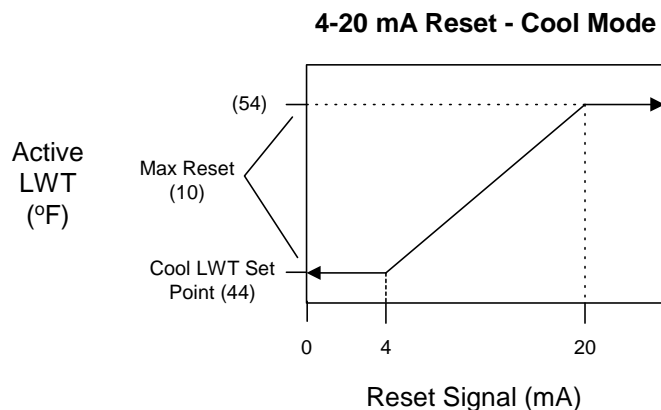

Unit Capacity Control

Unit capacity control is performed as described in this section.

Compressor Staging in Cool Mode

The first compressor on the unit is started when evaporator LWT is higher than the target plus the Startup Delta T set point.

An additional compressor is started when Evaporator LWT is higher than the target plus the Stage Up Delta T set point.

When multiple compressors are running, one will shut down if evaporator LWT is lower than the target minus the Stage Down Delta T set point.

The last compressor running will shut down when the evaporator LWT is lower than the target minus the Shut Down Delta T set point.

Compressor Staging in Heat Mode

The first compressor on the unit is started when Condenser LWT is lower than the target minus the Startup Delta T set point.

An additional compressor is started when Condenser LWT is lower than the target minus the Stage Up Delta T set point.

When multiple compressors are running, one will shut down if Condenser LWT is higher than the target plus the Stage Down Delta T set point.

The last compressor running will shut down when the Condenser LWT is higher than the target plus the Shut Down Delta T set point.

Stage Up Delay

A minimum amount of time will pass between compressors starting, which is defined by the Stage Up Delay set point. This delay will only apply when at least one compressor is running. If the first compressor starts and quickly fails on an alarm, another compressor will start without this minimum time passing.

Required Load For Stage Up

An additional compressor will not be started until all running compressors are at a capacity higher than the Load Stage Up set point, or running in a limited state.

Light Load Stage Down in Cool Mode

When multiple compressors are running, one will shut down if all running compressors are at a capacity lower than the Load Stage Down set point and the evaporator LWT is less than the target plus the Stage Up Delta T set point. A minimum amount of time will pass between compressors stopping as a result of this logic, which is defined by the Stage Down Delay set point.

Light Load Stage Down in Heat Mode

When multiple compressors are running, one will shut down if all running compressors are at a capacity lower than the Load Stage Down set point and the Condenser LWT is greater than the target minus the Stage Up Delta T set point. A minimum amount of time will pass between compressors stopping as a result of this logic, which is defined by the Stage Down Delay set point.

Maximum Circuits Running

If the number of compressors running is equal to the Max Circuits Running set point, no additional compressors will be started.

When multiple compressors are running, one will shut down if the number of compressors running is more than the Max Circuits Running set point.

Compressor Staging in Ice Mode

The first compressor will start when evaporator LWT is higher than the target plus the Startup Delta T set point.

When at least one compressor is running, the other compressors will start only when evaporator LWT is higher than the target plus the Stage Up Delta T set point.

All compressors will be staged off when evaporator LWT is less than the target.

Stage Up Delay

A fixed stage up delay of one minute between compressor starts is used in this mode.

When at least one compressor is running, the other compressors will start as quickly as possible with respect to the stage up delay.

Staging Sequence

This section defines which compressor is the next one to start or stop. In general, compressors with fewer starts will normally start first, and compressors with more run hours will normally stop first. Compressor staging sequence can also be determined by an operator defined sequence via setpoints.

Next To Start

The next compressor to start must meet the following requirements:

Lowest sequence number of those compressors available to start

- if sequence numbers are equal, it must have the least starts
- if starts are equal, it must have least run hours
- if run hours are equal, it must be the lowest numbered compressor

Next To Stop

The next compressor to shut down must meet the following requirements:

Lowest sequence number of the compressors that are running

- if sequence numbers are equal, it must have the most run hours
- if run hours are equal, it must be the lowest numbered compressor

Compressor Capacity Control In Cool Mode

In Cool mode, evaporator LWT is controlled to within **0.2 °C** (0.4 °F) of the target under constant flow conditions by controlling capacity of the individual compressors.

Compressors are loaded with a fixed step scheme. The rate of capacity adjustment is determined by the time between capacity changes. The farther away from the target, the faster compressors will be loaded or unloaded.

The logic projects ahead to avoid overshoot, such that the overshoot does not cause the unit to shut off due to evaporator LWT dropping below the target minus the Shutdown Delta T set point while there is still a load on the loop at least equal to the minimum unit capacity.

Capacity of the compressors is controlled so that when possible their capacities are balanced.

Circuits that are running in manual capacity control or running with active capacity limiting events are not considered in the capacity control logic.

The compressor capacities are adjusted one at a time while maintaining a capacity imbalance that does not exceed 12.5%.

Load/Unload Sequence

This section defines which compressor is the next one to load or unload.

Next To Load

The next compressor to load meets the following requirements:

Lowest capacity of the running compressors that can load up

- if capacities are equal, it must have the highest sequence number of the compressors that are running
- if the sequence numbers are equal, it must have the least run hours
- if run hours are equal, it must have the most starts
- if starts are equal, it must be the highest numbered compressor

Next To Unload

The next compressor to unload must meet the following requirements:

Highest capacity of the running compressors

- if capacities are equal, it must have the lowest sequence number of the compressors that are running
- if sequence numbers are equal, it must have the most run hours
- if run hours are equal, it must have the least starts
- if starts are equal, it must be the lowest numbered compressor

Pressure ratio limitation

Depending on Pressure Ratio the minimum and maximum compressors capacities can change. These change can affect the capacity control changing the minimum unit capacity. The two capacity limits depend on slide type (HSA or HSW) and are calculated using different coefficients.

Compressor Capacity Control In Ice Mode

In Ice mode, running compressors are loaded up simultaneously at the maximum possible rate that allows for stable operation of the individual circuits.

EXV Control

The EXV positioning is determined as described in the following sections, with adjustments made in increments of 0.1% of the total range.

The number of Expansion valves is linked with number of compressors, one valve per each compressor is foreseen.

Preopen Operation

The EXV control includes a preopen operation. Preopening percentage is set by default to 0% and is kept for future uses.

Startup Operation

When the first compressor starts a Pressure target value is calculated as (Low Pressure Hold setpoint + 20kPa). Then the target is increased continuously with a certain kPa/hour rate until the target for normal operation is reached. Then the control changes to Normal Operation (Pressure Control).

Normal Operation (Pressure Control)

Normal operation of the EXV is used to control the refrigerant level in the evaporator and condenser to maximize the system efficiency. Base target is calculated as a function of evaporator approach. This target is then corrected to guarantee a proper oil separation and filling of the heat exchangers.

The minimum discharge superheat between the two compressors is averaged and the result is used to calculate a correction. When the average Discharge superheat drops below a setpoint value a correction is applied to reduce the final pressure target. No correction is applied if the discharge superheat will remain higher than the Discharge superheat nominal value.

An additional correction is applied as a function of Suction superheat. The maximum Suction superheat value is compared with Suction superheat setpoint. An algorithm is then used to determine the correction value. This calculated value will increase or decrease the final pressure target in order to keep the setpoint within 0.2dK from the target. Correction can change depending on the operational conditions.

Manual Control

The EXV position can be set manually. Manual control can only be selected when the EXV state is Pressure. At any other time, the EXV control set point is forced to auto.

When EXV control is set to manual, the Pressure target is equal to the manual Pressure target. If set to manual when the circuit state transitions from run to another state, the control setting is automatically set back to auto. If EXV control is changed from manual back to auto while the circuit state remains run, the EXV state goes back to the normal operations.

Unit Capacity Overrides

Unit capacity limits can be used to limit total unit capacity in Cool mode only. Multiple limits may be active at any time, and the lowest limit is always used in the unit capacity control.

Soft load, demand limit, and network limit use a deadband around the actual limit value, such that unit capacity increase is not allowed within this deadband. If unit capacity is above the deadband, capacity is decreased until it is back within the deadband.

- For 1 and 2 compressors units, the deadband is 7%.

Soft Load

Soft Loading is a configurable function used to ramp up the unit capacity over a given time. The set points that control this function are:

- Soft Load – (ON/OFF)
- Begin Capacity Limit – (Unit %)
- Soft Load Ramp – (seconds)

The Soft Load Unit Limit increases linearly from the Begin Capacity Limit set-point to 100% over the amount of time specified by the Soft Load Ramp set-point. If the option is turned off, the soft load limit is set to 100%.

Demand Limit

The maximum unit capacity can be limited by a 4 to 20 mA signal on the Demand Limit analog input at the unit controller. This function is only enabled if the Demand Limit set point is set to ON.

As the signal varies from 4 mA up to 20 mA, the maximum unit capacity changes by steps of 1% from 100% to 0%. The unit capacity is adjusted as needed to meet this limit, except that the last running compressor cannot be turned off to meet a limit lower than the minimum unit capacity.

Network Limit

The maximum unit capacity can be limited by a network signal. This function is only enabled if the unit control source is set to network. The signal will be received through the BAS interface on the unit controller.

As the signal varies from 0% up to 100%, the maximum unit capacity changes from 0% to 100%. The unit capacity is adjusted as needed to meet this limit, except that the last running compressor cannot be turned off to meet a limit lower than the minimum unit capacity.

Current Limit

Current Limit control is enabled only when the current limit enable input is closed.

Unit current is calculated based on the 4-20 mA input that receives a signal from an external device. The current at 4 mA is assumed to be 0, and the current at 20 mA is defined by a set point. As the signal varies from 4 to 20 mA, the calculated unit current varies linearly from 0 amps to the amp value defined by the set point.

The current limit uses a deadband centered around the actual limit value, such that unit capacity increase is not allowed when current is within this deadband. If unit current is

above the deadband, capacity is decreased until it is back within the deadband. The current limit deadband is 10% of the current limit.

Maximum LWT Pulldown Rate

The maximum rate at which the leaving water temperature can drop is limited by the Maximum Rate set point, only when the LWT is less than **15°C (60°F)**.

If the pulldown rate is too fast, the unit capacity is reduced until the rate is less than the Maximum Pulldown Rate set point.

High Water Temperature Capacity Limit

If the evaporator LWT exceeds **18 °C (65°F)**, compressor load will be limited to a maximum of 75%. Compressors will unload to 75% or less if running at greater than 75% load when the LWT exceeds the limit.

A dead-band placed below the limit set-point will be used to increase function stability. If the actual capacity is in the band, unit loading will be inhibited.

Compressor Functions

Calculations

Suction Superheat

Suction superheat is calculated for each circuit using the following equation:

$$\text{Suction superheat} = \text{Suction Temperature} - \text{Evaporator Saturated Temperature}$$

Discharge Superheat

Discharge superheat is calculated for each circuit using the following equation:

$$\text{Discharge superheat} = \text{Discharge Temperature} - \text{Condenser Saturated Temperature}$$

Oil Differential Pressure

Oil Differential Pressure is calculated for each circuit with this equation:

$$\text{Oil Differential Pressure} = \text{Condenser Pressure} - \text{Oil Pressure}$$

Compressor Control Logic

Compressor Availability

A compressor is available to start if the following conditions are true:

- Compressor switch is closed
- No compressor alarms are active
- Compressor Mode set point is set to Enable
- BAS Compressor Mode set point is set to Auto
- No cycle timers are active
- Discharge Temperature is at least 5°C higher than Oil Saturated Temperature

Starting

The circuit will start if all these conditions are true:

- Adequate pressure in the evaporator and condenser (see No Pressure At Start Alarm)
- Compressor Switch is closed
- Compressor Mode set point is set to Enable
- BAS Compressor Mode set point is set to Auto
- No cycle timers are active
- No alarms are active
- Staging logic requires this compressor to start
- Unit state is Auto
- Evaporator pump state is Run
- Condenser pump state is Run

Compressor Startup Logic

Compressor startup is the time period following the starting of the compressor on a circuit. During the startup, the discharge superheat will be evaluated and used to keep compressor at minimum capacity until a minimum value is reached.

Stopping

Normal Shutdown

A normal shutdown is done in two different ways depending on the number of compressors running.

In case two circuits are running the compressor required to shutdown will download to minimum capacity and then switched off. No action is taken by the EXV which will follow the capacity change adjusting the opening.

The compressor will do a pumpdown stop if any of the following are true:

- Staging logic requires this compressor to stop but another is still running
- Unit State is Pumpdown

- Compressor switch is open but another compressor is still running
- Compressor Mode set point is set to Disable but another compressor is still running
- BAS Compressor Mode set point is set to Off but another compressor is still running

Pumpdown Stop

When the circuit has to be shutdown a pumpdown is performed before the compressor is turned off. This is done by closing the EXV.

The compressor will do a pumpdown stop if any of the following are true:

- Staging logic requires this Circuit to stop
- Unit State is Pumpdown
- Compressor switch is open and no other compressor is running
- Circuit Mode set point is set to Disable and no other compressor is running
- BAS Circuit Mode set point is set to Off and no other compressor is running

The normal shutdown is complete when any of the following are true:

- Evaporator Pressure is less than the Pumpdown Pressure set point
- Circuit has been pumping down for longer than the Pumpdown Time Limit setpoint

Rapid Shutdown

A rapid shutdown requires the compressor to stop and to go to the Off state immediately.

The circuit will do a rapid shutdown if either of these conditions occurs at any time:

- Unit State is Off
- A rapid stop alarm occurs on the compressor

Compressor Status

The displayed compressor status is determined by the conditions in the following table:

Enum	Status	Conditions
0	Off ready	Compressor is ready to start when needed.
1	Off stage up delay	Compressor is off and cannot start due to stage up delay.
2	Off cycle timer	Compressor is off and cannot start due to active cycle timer.
3	Off bas disable	Compressor is off and cannot start due to BAS disable.
4	Off comp switch	Compressor is off and circuit switch is off.
5	Off oil heating	Compressor is off and Discharge Temperature – Oil Saturated Temperature at gas pressure $\leq 5^{\circ}\text{C}$
6	Off alarm	Compressor is off and cannot start due to active circuit alarm.
7	Test mode	Compressor is in test mode.
8	Run normal	Compressor is in run state and running normally.
9	Run disch sh low	Compressor is in run state but discharge superheat is low and compressor is unloading to build it up.
10	Run max allwd cap	Compressor is in run state and the maximum allowed capacity has been reached.
11	Run min allwd cap	Compressor is in run state and the minimum allowed capacity has been reached.
12	Shut down	Compressor is unloading before to stop
13	Run warm up	Compressor is in run state and the discharge superheat is going to be build
14	Run High Lwt Limit	Circuit is running and cannot load due to high condenser pressure.

Compressor Control

The compressor will run only in a run or shutdown state.

Cycle Timers

A minimum time between starts of the compressor and a minimum time between shutdown and start of the compressor will be enforced. The time values are set by global circuit set points.

These cycle timers are enforced even through cycling of power to the chiller.

These timers may be cleared via a setting on the controller.

Compressor Capacity Control

After starting, the compressor will be unloaded to the minimum physical capacity and no attempt to increase compressor capacity is made until the differential between evaporator pressure and oil pressure meets a minimum value.

After the minimum differential pressure is met, compressor capacity is controlled to 25%.

Capacity will not be increased above 25% until discharge superheat has been at least 5°C for a time of at least 30 seconds.

Manual capacity control

The capacity of the compressor can be controlled manually. Manual capacity control is enabled via a set point with choices of auto or manual. Another set point allows setting the compressor capacity from 25% to 100%.

The compressor capacity is controlled to the manual capacity set point. Changes will be made at a rate equal to the maximum rate that allows stable circuit operation.

Capacity control reverts back to automatic control if either:

- the compressor shuts down for any reason
- capacity control has been set to manual for four hours

Slide Control Solenoids (Symmetric compressors)

This section applies to the following compressor models:

Model	Name plate
F4221	HSA205 – HSW205
F4222	HSA220 – HSW220
F4223	HSA235 – HSW235
F4224	HSA243 – HSW243

The required capacity is achieved by controlling the modulating slide. The modulating slide can control 25% to 100% of the total compressor capacity, infinitely variable.

The modulating slide is moved by pulsing of the load and unload solenoids to achieve the required capacity.

Capacity Overrides – Limits of Operation

The following conditions override automatic capacity control when the chiller is in COOL mode. These overrides keep the circuit from entering a condition in which it is not designed to run.

Low Evaporator Pressure

If the Low Evaporator Pressure Hold event is triggered, the compressor will not be allowed to increase in capacity.

If the Low Evaporator Pressure Unload event is triggered, the compressor will begin reducing capacity.

The compressor will not be allowed to increase in capacity until the Low Evaporator Pressure Hold event has cleared.

See the Circuit Events section for details on triggering, reset, and unloading action.

High Condenser Pressure

If the High Condenser Pressure Hold event is triggered, the compressor will not be allowed to increase capacity.

If the High Condenser Pressure Unload event is triggered, the compressor will begin reducing capacity.

The compressor will not be allowed to increase in capacity until the High Condenser Pressure Hold event has cleared.

See the Circuit Events section for details on triggering, reset, and unloading action.

Pressure Ratio Capacity Limit

Depending on the calculated Minimum and Maximum allowed capacities the compressor can modify its capacity accordingly to limitations.

Liquid Injection

Liquid injection is activated when the circuit is in a run state and the discharge temperature rises above the Liquid Injection Activation set point.


Liquid injection is turned off when the discharge temperature decreases below the activation set point by a differential of 10°C.

Alarms and Events

Situations may arise that require some action from the chiller or that should be logged for future reference. A condition that requires a shutdown and/or lockout is an alarm. Alarms may cause a normal stop (with pumpdown) or a rapid stop. Most alarms require manual reset, but some reset automatically when the alarm condition is corrected. Other conditions can trigger what is known as an event, which may or may not cause the chiller to respond with a specific action in response. All alarms and events are logged.

Signaling Alarms

The following actions will signal that an alarm has occurred:

1. The unit or a circuit will execute a rapid or pumpdown shutoff.
2. An alarm bell icon  will be displayed in the upper right-hand corner of all controller screens including the optional remote user interface panel's screens.
3. An optional field supplied and wired remote alarm device will be activated.

Clearing Alarms

Active alarms can be cleared through the keypad/display or a BAS network. Alarms are automatically cleared when controller power is cycled. Alarms are cleared only if the conditions required to initiate the alarm no longer exist. All alarms and groups of alarms can be cleared via the keypad or network via LON using `nviClearAlarms` and via BACnet using the `ClearAlarms` object

To use the keypad, follow the Alarm links to the Alarms screen, which will show Active Alarms and Alarm Log. Select Active Alarm and press the wheel to view the Alarm List (list of current active alarms). They are in order of occurrence with the most recent on top. The second line on the screen shows Alm Cnt (number of alarms currently active) and the status of the alarm clear function. Off indicates that the Clear function is off and the alarm is not cleared. Press the wheel to go to the edit mode. The Alm Clr (alarm clear) parameter will be highlighted with OFF showing. To clear all alarms, rotate the wheel to select ON and enter it by pressing the wheel.

An active password is not necessary to clear alarms.

If the problem(s) causing the alarm have been corrected, the alarms will be cleared, disappear from the Active Alarm list and be posted in the Alarm Log. If not corrected, the On will immediately change back to OFF and the unit will remain in the alarm condition.

Remote Alarm Signal

The unit is configured to allow field wiring of alarm devices. Refer to unit onboard documentation for field wiring information.

Description of Alarms

Phase Volts Loss/GFP Fault

Alarm description (as shown on screen): `UnitOffPhaseVoltage`

Trigger: PVM set point is set to Single Point and PVM/GFP input is low

Action Taken: Rapid stop all compressors

Reset: Auto reset when PVM input is high or PVM set point does not equal single point for at least 5 seconds.

Evaporator Flow Loss

Alarm description (as shown on screen): `UnitOffEvapWaterFlow`

Trigger:

- 1: Evaporator Pump State = Run AND Evaporator Flow Digital Input = No Flow for time > Flow Proof Set Point AND at least one compressor running
- 2: Evaporator Pump State = Start for time greater than Recirc Timeout Set Point and all pumps have been tried

Action Taken: Rapid stop all compressors

Reset:

This alarm can be cleared at any time manually via the keypad or via the BAS clear alarm signal.

If active via trigger condition 1:

When the alarm occurs due to this trigger, it can auto reset the first two times each day, with the third occurrence being manual reset.

For the auto reset occurrences, the alarm will reset automatically when the evaporator state is Run again. This means the alarm stays active while the unit waits for flow, then it goes through the recirculation process after flow is detected. Once the recirculation is complete, the evaporator goes to the Run state which will clear the alarm. After three occurrences, the count of occurrences is reset and the cycle starts over if the manual reset flow loss alarm is cleared.

If active via trigger condition 2:

If the flow loss alarm has occurred due to this trigger, it is always a manual reset alarm.

Evaporator Water Freeze Protect

Alarm description (as shown on screen): UnitOffEvapWaterTmpLo

Trigger: Evaporator LWT or EWT drops below evaporator freeze protect set point. If the sensor fault is active for either LWT or EWT, then that sensor value cannot trigger the alarm.

Action Taken: Rapid stop all compressors

Reset: This alarm can be cleared manually via the keypad or via the BAS clear alarm signal, but only if the alarm trigger conditions no longer exist.

Evaporator Water Temperatures Inverted

Alarm description (as shown on screen): UnitOffEvpWTempInvtrd

Trigger: Evap EWT < Evap LWT - 1 deg C AND at least one circuit is running AND EWT sensor fault not active AND LWT sensor fault not active] for 30 seconds

Action Taken: Pumpdown stop on all compressors

Reset: This alarm can be cleared manually via the keypad.

Leaving Evaporator Water Temperature Sensor Fault

Alarm description (as shown on screen): UnitOffEvplvgWTemp

Trigger: Sensor shorted or open

Action Taken: Rapid stop all compressors

Reset: This alarm can be cleared manually via the keypad, but only if the sensor is back in range.

Entering Evaporator Water Temperature Sensor Fault

Alarm description (as shown on screen): UnitOffEvpeWTemp

Trigger: Sensor shorted or open

Action Taken: Rapid stop all compressors

Reset: This alarm can be cleared manually via the keypad, but only if the sensor is back in range.

Condenser Water Freeze Protect

Alarm description (as shown on screen): UnitOffCondWaterTmpLo

Trigger: Condenser LWT or EWT drops below evaporator freeze protect set point. If the sensor fault is active for either LWT or EWT, then that sensor value cannot trigger the alarm.

Action Taken: Rapid stop all compressors

Reset: This alarm can be cleared manually via the keypad or via the BAS clear alarm signal, but only if the alarm trigger conditions no longer exist.

Condenser Water Temperatures Inverted in Cool Mode

Alarm description (as shown on screen): UnitOffCondInvAl

Trigger: Cond EWT > Cond LWT - 1 deg C AND at least one circuit is running AND EWT sensor fault not active AND LWT sensor fault not active] for 30 seconds

Action Taken: Pumpdown stop on all compressors

Reset: This alarm can be cleared manually via the keypad.

Leaving Condenser Water Temperature Sensor Fault

Alarm description (as shown on screen): UnitOffCndLvgWTemp

Trigger: Sensor shorted or open

Action Taken: Rapid stop all compressors

Reset: This alarm can be cleared manually via the keypad, but only if the sensor is back in range.

Entering Condenser Water Temperature Sensor Fault

Alarm description (as shown on screen): UnitOffCndEntWTemp

Trigger: Sensor shorted or open

Action Taken: Rapid stop all compressors

Reset: This alarm can be cleared manually via the keypad, but only if the sensor is back in range.

Evaporator Pressure Sensor Fault

Alarm description (as shown on screen): EvapPressSensFault N

Trigger: Sensor shorted or open

Action Taken: Rapid stop all compressors

Reset: This alarm can be cleared manually via the keypad, but only if the sensor is back in range.

Condenser Pressure Sensor Fault

Alarm description (as shown on screen): CondPressSensFault N

Trigger: Sensor shorted or open

Action Taken: Rapid stop all compressors

Reset: This alarm can be cleared manually via the keypad, but only if the sensor is back in range.

Condenser Flow Loss

Alarm description (as shown on screen): UnitOffCondWaterFlow

Trigger:

1: Condenser Pump State = Run AND Condenser Flow Digital Input = No Flow for time > Flow Proof Set Point AND at least one compressor running

2: Condenser Pump State = Start for time greater than Recirc Timeout Set Point

Action Taken: Rapid stop all compressors

Reset:

This alarm can be cleared at any time manually via the keypad or via the BAS clear alarm signal.

Low Evaporator Pressure

Alarm description (as shown on screen): UnitOffEvapPrLow

Trigger: [Freezestat trip AND Circuit State = Run] OR Evaporator Press < -69kPa

Freezestat logic allows the circuit to run for varying times at low pressures. The lower the pressure, the shorter the time the compressor can run. This time is calculated as follows:

Freeze error = Low Evaporator Pressure Unload – Evaporator Pressure
Freeze time = 70 – 6.25 x freeze error, limited to a range of 20-70 seconds

When the evaporator pressure goes below the Low Evaporator Pressure Unload set point, a timer starts. If this timer exceeds the freeze time, then a freezestat trip occurs. If the evaporator pressure rises to the unload set point or higher, and the freeze time has not been exceeded, the timer will reset.

The alarm cannot trigger if the evaporator pressure sensor fault is active.

Action Taken: Rapid stop all compressors

Reset: This alarm can be cleared manually if the evaporator pressure is above – 69kPa

High Condenser Pressure

Alarm description (as shown on screen): UnitOffCondPrHigh

Trigger: Condenser Saturated Temperature > Max Saturated Condenser Value for time > High Cond Delay set point.

Action Taken: Rapid stop circuit

Reset: This alarm can be cleared manually via the Unit Controller keypad

No Pressure Change After Start

Alarm description (as shown on screen): NoPressChgAtStrt N

Trigger: After start of compressor, at least a 1 psi drop in evaporator pressure OR 5 psi increase in condenser pressure has not occurred after 15 seconds

Action Taken: Rapid stop all compressors

Reset: This alarm can be cleared manually via the Unit Controller keypad.

External Alarm

Alarm description (as shown on screen): UnitOffExternalAlarm

Trigger: External Alarm/Event input is open for at least 5 seconds and external fault input is configured as an alarm.

Action Taken: Rapid stop of all compressors.

Reset: Auto clear when digital input is closed.

Emergency Stop Alarm

Alarm description (as shown on screen): UnitOffEmergencyStop

Trigger: Emergency Stop input is open.

Action Taken: Rapid stop of all compressors.

Reset: This alarm can be cleared manually via the keypad if the switch is closed.

HP Comm Failure

Alarm description (as shown on screen): HeatPCtrlrCommFail

Trigger: Communication with the I/O extension module has failed.

Action Taken: Pumpdown stop on all compressors

Reset: This alarm can be cleared manually via the keypad when communication between main controller and the extension module is working for 5 seconds.

Unit Events

The following unit events are logged in the event log with a time stamp.

Low Evaporator Pressure - Hold

Event description (as shown on screen): EvapPress Low Hold N

Trigger: This event is not enabled until the circuit startup is complete and the unit mode is Cool. While running, if evaporator pressure \leq Low Evaporator Pressure Hold set point the event is triggered.

Action Taken: Inhibit loading on all running compressors.

Reset: While still running, the event will be reset if evaporator pressure $>$ (Low Evaporator Pressure Hold SP + 14kPa). The event is also reset if the unit mode is switched to Ice, or the circuit is no longer in the run state.

Low Evaporator Pressure - Unload

Event description (as shown on screen): EvapPressLowUnload N

Trigger: This event is not enabled until the circuit startup is complete and the unit mode is Cool. Then, while running, if evaporator pressure \leq Low Evaporator Pressure Unload set point the event is triggered

Action Taken: Unload the compressors by decreasing the capacity by one step every 5 seconds until the evaporator pressure rises above the Low Evaporator Pressure Unload set point.

Reset: While still running, the event will be reset if evaporator pressure $>$ (Low Evaporator Pressure Unload SP + 14kPa). The event is also reset if the unit mode is switched to Ice, or the circuit is no longer in the run state.

High Condenser Pressure - Hold

Event description (as shown on screen): CondPressHigh Hold N

Trigger: While the compressor is running and unit mode is Cool, if saturated condenser temperature \geq High Saturated Condenser Hold Value, the event is triggered.

Action Taken: Inhibit loading on all running compressors.

Reset: While still running, the event will be reset if saturated condenser temperature $<$ (High Saturated Condenser Hold Value – 10°F). The event is also reset if the unit mode is switched to Ice, or the circuit is no longer in the run state.

High Condenser Pressure - Unload

Event description (as shown on screen): CondPressHighUnloadN

Trigger: While the compressor is running and unit mode is Cool, if saturated condenser temperature \geq High Saturated Condenser Unload Value, the event is triggered.

Action Taken: Unload the compressor by decreasing the capacity by one step every 5 seconds until the evaporator pressure rises above the High Condensing Pressure Unload set point.

Reset: While still running, the event will be reset if saturated condenser temperature $<$ (High Saturated Condenser Unload Value – 10°F). The event is also reset if the unit mode is switched to Ice, or the circuit is no longer in the run state.

Unit Power Restore

Event description (as shown on screen): UnitPowerRestore

Trigger: Unit controller is powered up.

Action Taken: none

Reset: none

External Event

Alarm description (as shown on screen): External Event

Trigger: External Alarm/Event input is open for at least 5 seconds and external fault is configured as an event.

Action Taken: None

Reset: Auto clear when digital input is closed.

Compressor Stop Alarms

All circuit stop alarms require shutdown of the circuit on which they occur. Rapid stop alarms do not do a pumpdown before shutting off. All other alarms will do a pumpdown.

When one or more circuit alarms are active and no unit alarms are active, the alarm output will be switched on and off on 5 second intervals.

Alarm descriptions apply to all circuits, the circuit number is represented by 'N' in the description.

Mechanical Low Pressure Switch

Alarm description (as shown on screen): C1CmpN OffMechPressLo

Trigger: Mechanical Low Pressure switch input is low

Action Taken: Rapid stop compressor.

Reset: This alarm can be cleared manually via the Unit Controller keypad if the MLP switch input is high.

Low Discharge Superheat

Alarm description (as shown on screen): C1CmpN OffDischSHLo

Trigger: Discharge superheat < setpoint limit for a time > Low Discharge Superheat Delay set point when the circuit is in Run state.

Action Taken: Rapid stop compressor

Reset: alarm can be cleared manually via the Unit Controller keypad

Low Pressure Ratio

Alarm description (as shown on screen): C1CmpN OffPrRatioLo

Trigger: Pressure ratio < calculated limit for a time > Low Pressure Ratio Delay set point after circuit startup has completed. The calculated limit will vary from 1.4 to 1.8 as the compressor's capacity varies from 25% to 100%.

Action Taken: Normal shutdown of compressor

Reset: alarm can be cleared manually via the Unit Controller keypad

Mechanical High Pressure Switch

Alarm description (as shown on screen): C1CmpN OffMechPressHi

Trigger: Mechanical High Pressure switch input is low AND Emergency Stop Alarm is not active.

(opening emergency stop switch kills power to MHP switches)

Action Taken: Rapid stop compressor

Reset: This alarm can be cleared manually via the Unit Controller keypad if the MHP switch input is high.

Compressor Starter Fault

Alarm description (as shown on screen): C1CmpN OffStarterFlt

Trigger: If compressor has been running for at least 14 seconds and starter fault input is open.

Action Taken: Rapid stop circuit

Reset: This alarm can be cleared manually via the Unit Controller keypad.

High Discharge Temperature

Alarm description (as shown on screen): Disc Temp High N

Trigger: Discharge Temperature > High Discharge Temperature set point AND compressor is running. Alarm cannot trigger if discharge temperature sensor fault is active.

Action Taken: Rapid stop compressor

Reset: This alarm can be cleared manually via the Unit Controller keypad.

High Oil Pressure Difference

Alarm description (as shown on screen): C1CmpN OffOilPrDiffHi

Trigger: Oil Pressure Differential > High Oil Pressure Differential set point for a time greater than Oil Pressure Differential Delay.

Action Taken: Rapid stop compressor

Reset: This alarm can be cleared manually via the Unit Controller keypad.

High Motor Temperature

Alarm description (as shown on screen): C1CmpN OffMotorTempHi

Trigger:

Input value for the motor temperature is 4500 ohms or higher.

Action Taken: Rapid stop compressor

Reset: This alarm can be cleared manually via the Unit Controller keypad after input value for motor temperature has been 200 ohms or less for at least 5 minutes.

CC Comm Failure N

Alarm description (as shown on screen): C1OffCmpNCtrlrComFail

Trigger: Communication with the I/O extension module has failed. Section 3.1 indicates the expected type of module and the address for each module.

Action Taken: Rapid stop of affected compressor

Reset: This alarm can be cleared manually via the keypad when communication between main controller and the extension module is working for 5 seconds.

EEXV Comm Failure N

Alarm description (as shown on screen): C1OffEXVNCtrlrComFail

Trigger: Communication with the I/O extension module has failed. Section 3.1 indicates the expected type of module and the address for each module.

Action Taken: Rapid stop of affected compressor

Reset: This alarm can be cleared manually via the keypad when communication between main controller and the extension module is working for 5 seconds.

Oil Pressure Sensor Fault

Alarm description (as shown on screen): C1CmpN OffOilFeedP

Trigger: Sensor shorted or open

Action Taken: Normal shutdown of compressor

Reset: This alarm can be cleared manually via the keypad, but only if the sensor is back in range.

Suction Temperature Sensor Fault

Alarm description (as shown on screen): SuctTempSensFault N

Trigger: Sensor shorted or open

Action Taken: Normal shutdown of compressor

Reset: This alarm can be cleared manually via the keypad, but only if the sensor is back in range.

Discharge Temperature Sensor Fault

Alarm description (as shown on screen): DiscTempSensFault N

Trigger: Sensor shorted or open

Action Taken: Normal shutdown of compressor

Reset: This alarm can be cleared manually via the keypad, but only if the sensor is back in range.

Motor Temperature Sensor Fault

Alarm description (as shown on screen): C1CmpN OffMtrTempSen

Trigger: Sensor shorted or open

Action Taken: Rapid stop compressor

Reset: This alarm can be cleared manually via the keypad, but only if the sensor is back in range.

Slide Position Sensor Fault

Alarm description (as shown on screen): C1CmpN OffSlidePosSen

Trigger: Sensor shorted or open

Action Taken: Rapid stop compressor

Reset: This alarm can be cleared manually via the keypad, but only if the sensor is back in range.

Compressor Events

The following events limit operation of the circuit in some way as described in the Action Taken column. The occurrence of a circuit event only affects the circuit on which it occurred. Circuit events are logged in the event log on the unit controller.

Power Loss While Running

Event description (as shown on screen): Run Power Loss Cmp N

Trigger: Circuit controller is powered up after losing power while compressor was running

Action Taken: N/A

Reset: N/A

Alarm Logging


When an alarm occurs, the alarm type, date, and time are stored in the active alarm buffer corresponding to that alarm (viewed on the Alarm Active screens) also in the alarm history buffer (viewed on the Alarm Log screens). The active alarm buffers hold a record of all current alarms.

A separate alarm log stores the last 25 alarms to occur. When an alarm occurs, it is put into the first slot in the alarm log and all others are moved down one, dropping the last alarm. In the alarm log, the date and time the alarm occurred are stored. The alarm log also stores the date and time when the reset of the alarms occur.

Using the Controller

The Unit Controller Operation

Unit Controller

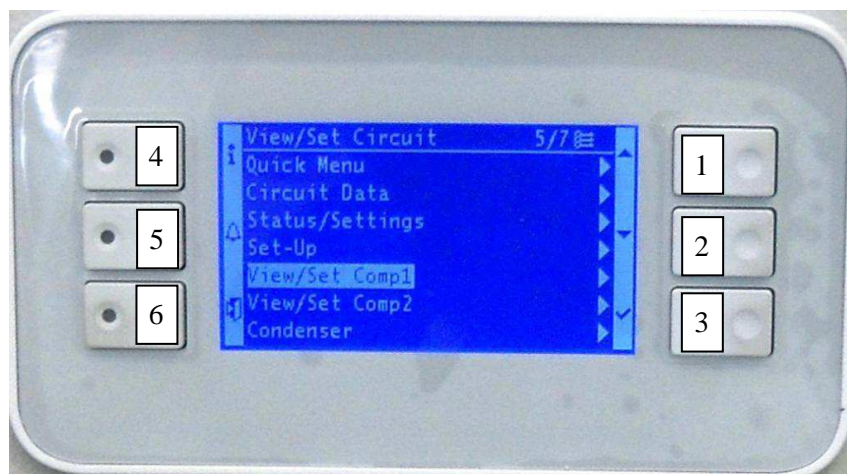

The units are equipped with an external display with six navigation button. The connection is done with a standard Ethernet patch cable.

The function of each button is as follow:

1	Scroll UP/Increase value
2	Scroll DOWN/Decrease value
3	Enter SubMenu/Accept new value
4	Main Menu
5	Alarm Page
6	Back to the previous page

By pressing button 6 for 5 seconds a configuration menu will be shown. This menu will permit to modify the appearance of the display reverting from blue background to white background. It will also allow to change the contrast.

Up to 7 lines are displayed on each page.

Figure 5, Typical Screen

◆6	View/Set Unit 3
Status/Settings	>
Set Up	>
Temperature	>
Date/Time/Schedule	>

Generally, each line contains a menu title, a parameter (such as a value or a setpoint), or a link (which will have an arrow in the right of the line) to a further menu.

The first line visible on each display includes the menu title and the line number to which the cursor is currently “pointing”, in the above case 3. The selected line is highlighted.

Each line on a page can contain status only information or include changeable data fields (setpoints). When a line contains status only information and the cursor is on that line, all but the value field of that line is highlighted, meaning the text is white with a black box around it. When the line contains a changeable value and the cursor is at that line, the entire line is highlighted.

A line in a menu may be a link to further menus. This is often referred to as a jump line, meaning pushing the navigation wheel will cause a “jump” to a new menu. An arrow (>) is displayed to the far right of the line to indicate it is a “jump” line and the entire line is highlighted when the cursor is on that line.

NOTE - Only menus and items that are applicable to the specific unit configuration are displayed.

This manual includes information relative to the operator level of parameters; data and setpoints necessary for the every day operation of the chiller. There are more extensive menus available for the use of service technicians.

Navigating

When power is applied to the control circuit, the controller screen will be active and display the Home screen, which can also be accessed by pressing the Menu Button. The navigating wheel is the only navigating device necessary, although the MENU, ALARM, and BACK buttons can provide shortcuts as explained later.

Passwords

The home screen has eleven lines:

- Enter Password, links to the Entry screen, which is an editable screen. So pressing the wheel goes to the edit mode where the password (5321) can be entered. The first (*) will be highlighted, rotate the wheel clockwise to the first number and set it by pressing the wheel. Repeat for the remaining three numbers.

The password will time out after 10 minutes of inactivity and is cancelled if a new password is entered or the control powers down.

- Other basic information and links are shown on the Main Menu page for ease of usage and includes Active setpoint, Evaporator Leaving Water Temperature, etc. The About Chiller link connects to a page where it is possible to see the software version.

Figure 6, Password Menu

	Main Menu	1/11
Enter Password		>
Unit Status=		
Auto		
Active Setpt=	xx.x°C	
Evap LWT=	xx.x°C	
Unit Capacity=	xxx.x%	
Unit Mode=	Cool	
Time Until Restart		>
Alarms		>
Scheduled Maintenance		>
About Chiller		>

Figure 7, Password Entry Page

Enter Password
Enter ****

Entering an invalid password has the same effect as continuing without a password.

Once a valid password has been entered, the controller allows further changes and access without requiring the user to enter a password until either the password timer expires or a different password is entered. The default value for this password timer is 10 minutes. It is changeable from 3 to 30 minutes via the Timer Settings menu in the Extended Menus.

Navigation Mode

When the navigation wheel is turned clockwise, the cursor moves to the next line (down) on the page. When the wheel is turned counter-clockwise the cursor moves to the previous line (up) on the page. The faster the wheel is turned the faster the cursor moves. Pushing the wheel acts as an “Enter” button.

Three types of lines exist:

- Menu title, displayed in the first line as in Figure 7.
- Link (also called Jump) having an arrow (>) in the right of the line and used to link to the next menu.
- Parameters with a value or adjustable setpoint.

For example, “Time Until Restart” jumps from level 1 to level 2 and stops there.

When the Back Button is pressed the display reverts back to the previously displayed page. If the Back button is repeated pressed the display continues to revert one page back along the current navigation path until the “main menu” is reached.

When the Menu (Home) Button is pressed the display reverts to the “main page.”

When the Alarm Button is depressed, the Alarm Lists menu is displayed.

Edit Mode

The Editing Mode is entered by pressing the navigation wheel while the cursor is pointing to a line containing an editable field. Once in the edit mode pressing the wheel again causes the editable field to be highlighted. Turning the wheel clockwise while the editable field is highlighted causes the value to be increased. Turning the wheel counter-clockwise while the editable field is highlighted causes the value to be decreased. The faster the wheel is turned the faster the value is increased or decreased. Pressing the

wheel again cause the new value to be saved and the keypad/display to leave the edit mode and return to the navigation mode.

A parameter with an “R” is read only; it is giving a value or description of a condition. An “R/W” indicates a read and/or write opportunity; a value can be read or changed (providing the proper password has been entered).

Example 1: Check Status, for example -is the unit being controlled locally or by an external network? We are looking for the Unit Control Source. Since this is a unit status parameter, start at Main Menu and select View/Set Unit and press the wheel to jump to the next set of menus. There will be an arrow at the right side of the box, indicating that a jump to the next level is required. Press the wheel to execute the jump.

You will arrive at the Status/ Settings link. There is an arrow indicating that this line is a link to a further menu. Press the wheel again to jump to the next menu, Unit Status/Settings.

Rotate the wheel to scroll down to Control Source and read the result.

Example 2; Change a Set point, the chilled water set point for example. This parameter is designated as Cool LWT Set point 1 and is a unit set parameter. From the Main Menu select View/Set Unit. The arrow indicated that this is link to a further menu.

Press the wheel and jump to the next menu View/Set Unit and use the wheel to scroll down to Temperatures. This again has an arrow and is a link to a further menu. Press the wheel and jump to the Temperatures menu, which contains six lines of temperatures set points. Scroll down to Cool LWT 1 and press the wheel to jump to the item change page. Rotate the wheel to adjust the set point to the desired value. When this is done press the wheel again to confirm the new value. With the Back button it will be possible to jump back to the Temperatures menu where the new value will be displayed.

Example 3; Clear an Alarm, The presence of a new alarm is indicated with a Bell ringing on the top right of the display. If the Bell is frozen one or more alarm had been acknowledged but are still active. To view the Alarm menu from the Main Menu scroll down to the Alarms line or simply press the Alarm button on the display. Note the arrow indicating this line is a link. Press the wheel to jump to the next menu Alarms. There are two lines here; Alarm Active and Alarm Log. Alarms are cleared from the Active Alarm link. Press the wheel to jump to the next screen. When the Active Alarm list is entered scroll to the item AlmClr which is set to off by default. Change this value to on to acknowledge the alarms. If the alarms can be cleared then the alarm counter will display 0 otherwise it will display the number of alarm still active. When the alarms are acknowledged the Bell on the top right of the display will stop to ring if some of the alarms are still active or will disappear if all the alarms are cleared.


Optional Remote User Interface

The optional remote user interface is a remote control panel that mimics operation of the controller located on the unit. Up to eight AWS units can be connected to it and selected on the screen. It provides HMI (Human Machine Interface) within a building, the building engineer's office for example, without going outdoors to the unit.

It can be ordered with the unit and shipped loose as a field installed option. It can also be ordered anytime after chiller shipment and mounted and wired on the job as explained on the following page. The remote panel is powered from the unit and no additional power supply is required.

All viewing and setpoint adjustments available on the unit controller are available on the remote panel. Navigation is identical to the unit controller as described in this manual.

The initial screen when the remote is turned on shows the units connected to it. Highlight the desired unit and press the wheel to access it. The remote will automatically show the units attached to it, no initial entry is required.

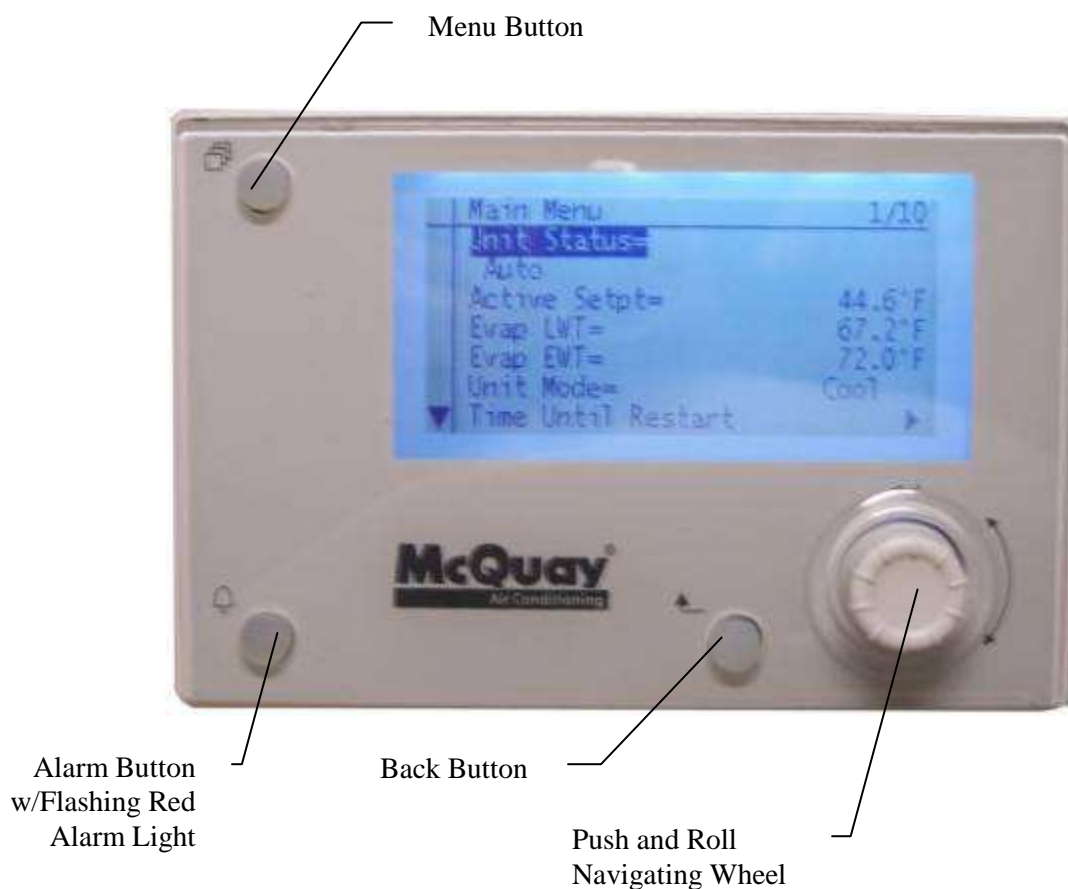

Technical Specifications

Interface

Process Bus	Up to eight interfaces per remote
Bus connection	CE+, CE-, not interchangeable
Terminal	2-screw connector
Max. length	700 m
Cable type	Twisted pair cable; 0.5...2.5 mm ²

Display

LCD type	FTN
Dimensions	5.7 W x 3.8 H x 1.5 D inches (144 x 96 x 38 mm)
Resolution	Dot-matrix 96 X 208 pixels
Backlight	Blue or white, user-configurable





Environmental Conditions

Operation	IEC 721-3-3
Temperature	-40 to 70 °C
Restriction LCD	-20 to 60 °C
Humidity	<90% r.h. (no condensation)
Air pressure	Min. 700 hPa, corresponding to Max. 3,000 m above sea level



Cover Removal

Process Bus Wiring Connections

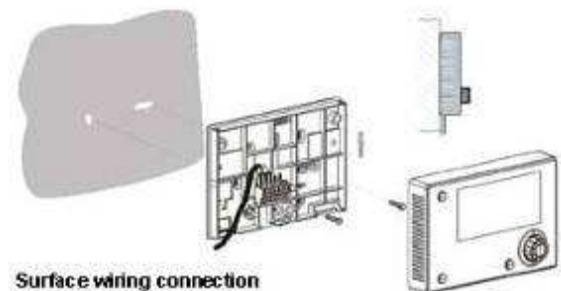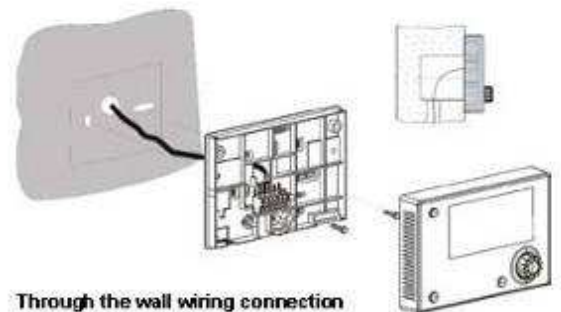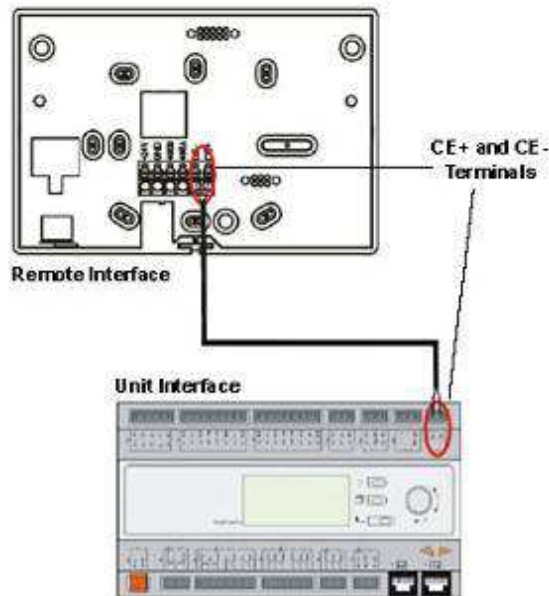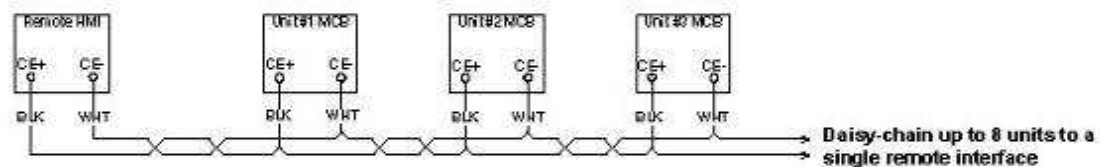

Start-up and Shutdown

NOTICE

Daikin service personnel or factory authorized service agency must perform initial start-up in order to activate warranty.

⚠ CAUTION

Most relays and terminals in the unit control center are powered when S1 is closed and the control circuit disconnect is on. Therefore, do not close S1 until ready for start-up or the unit may start unintentionally and possibly cause equipment damage.

Seasonal Start-up

1. Double check that the discharge shutoff valve and the optional compressor suction butterfly valves are open.
2. Check that the manual liquid-line shutoff valves at the outlet of the subcooler coils and the oil separator oil return line shutoff valves are open.
3. Check the leaving chilled water temperature setpoint on the MicroTech III controller to be sure it is set at the desired chilled water temperature.
4. Start the auxiliary equipment for the installation by turning on the local, and/or remote on/off switch, and chilled water pump.
5. Check to see that On/Off switches Q1 and Q2 are in the "Stop" (open) position. Throw the S1 switch to the "auto" position.
6. Under the "Control Mode" menu of the keypad, place the unit into the required operational mode.
7. Start the system by moving pumpdown switch Q1 to the "auto" position.
8. Repeat step 7 for Q2.

Temporary Shutdown

Move pumpdown switches Q1 and Q2 to the "Stop" position. After the compressors have pumped down, turn off the chilled water pump.

⚠ CAUTION

Do not turn the unit off using the "Override Stop" switch, without first moving Q1 and Q2 to the "Stop" position, unless it is an emergency, as this will prevent the unit from going through a proper shutdown/pumpdown sequence.

⚠ CAUTION

The unit has a one-time pumpdown operation. When Q1 and Q2 are in the "Stop" position the unit will pump down once and not run again until the Q1 and Q2 switches are moved to the auto position. If Q1 and Q2 are in the auto position and the load has been satisfied, the unit will go into one-time pumpdown and will remain off until the MicroTech III control senses a call for cooling and starts the unit.

⚠ CAUTION

Water flow to the unit must not be interrupted before the compressors pump down to avoid freeze-up in the evaporator. Interruption will cause equipment damage.

CAUTION

If all power to the unit is turned off, the compressor heaters will become inoperable. Once power is resumed to the unit, the compressor and oil separator heaters must be energized a minimum of 12 hours before attempting to start the unit.

Failure to do so can damage the compressors due to excessive accumulation of liquid in the compressor.

Start-up After Temporary Shutdown

1. Insure that the compressor and oil separator heaters have been energized for at least 12 hours prior to starting the unit (S1 switch can disable the heaters if pressed).
2. Start the chilled water pump.
3. With System switch Q0 in the "on" position, move switches Q1 and Q2 to the "auto" position.
4. Observe the unit operation until the system has stabilized.

Extended (Seasonal) Shutdown

1. Move the Q1 and Q2 switches to the manual Off position.
2. After the compressors have switched off, turn off the chilled water pump.
3. Turn off all power to the unit and to the chilled water pump.
4. If fluid is left in the evaporator, confirm that the evaporator heaters are operational.
5. Move the emergency stop switch S1 to the "off" position.
6. Close the compressor discharge valve and the optional compressor suction valve (if so equipped) as well as the liquid line shutoff valves.
7. Tag all opened compressor disconnect switches to warn against start-up before opening the compressor suction valve and liquid line shutoff valves.
8. If glycol is not used in the system, drain all water from the unit evaporator and chilled water piping if the unit is to be shutdown during winter and temperatures below -20°F can be expected. The evaporator is equipped with heaters to help protect it down to -20°F. Chilled water piping must be protected with field-installed protection. Do not leave the vessels or piping open to the atmosphere over the shutdown period.
9. Do not apply power to the evaporator heaters if the system is drained of fluids as this can cause the heaters to burn out.

Start-up After Extended (Seasonal) Shutdown

1. With all electrical disconnects locked and tagged out, check all screw or lug-type electrical connections to be sure they are tight for good electrical contact.

DANGER

LOCK AND TAG OUT ALL POWER SOURCES WHEN CHECKING CONNECTIONS. ELECTRICAL SHOCK WILL CAUSE SEVERE PERSONAL INJURY OR DEATH.

2. Check the voltage of the unit power supply and see that it is within the $\pm 10\%$ tolerance that is allowed. Voltage unbalance *between* phases must be within $\pm 3\%$.
3. See that all auxiliary control equipment is operative and that an adequate cooling load is available for start-up.
4. Check all compressor flange connections for tightness to avoid refrigerant loss. Always replace valve seal caps.

5. Make sure system switch Q0 is in the "Stop" position and On/Off switches Q1 and Q2 are set to "Stop", throw the main power and control disconnect switches to "on." This will energize the crankcase heaters. Wait a minimum of 12 hours before starting up unit. Turn compressor circuit breakers to "off" position until ready to start unit.
6. Open the optional compressor suction butterfly as well as the liquid line shutoff valves, compressor discharge valves.
7. Vent the air from the evaporator water side as well as from the system piping. Open all water flow valves and start the chilled water pump. Check all piping for leaks and recheck for air in the system. Verify the correct flow rate by taking the pressure drop across the evaporator and checking the pressure drop curves in the installation manual, IMM AGSC-2.
8. The following table gives glycol concentrations required for freeze protection.

Table 2, Freeze Protection

Temperature °F (°C)	Percent Volume Glycol Concentration Required			
	For Freeze Protection		For Burst Protection	
	Ethylene Glycol	Propylene Glycol	Ethylene Glycol	Propylene Glycol
20 (6.7)	16	18	11	12
10 (-12.2)	25	29	17	20
0 (-17.8)	33	36	22	24
-10 (-23.3)	39	42	26	28
-20 (-28.9)	44	46	30	30
-30 (-34.4)	48	50	30	33
-40 (-40.0)	52	54	30	35
-50 (-45.6)	56	57	30	35
-60 (-51.1)	60	60	30	35

Notes:

1. These figures are examples only and cannot be appropriate to every situation. Generally, for an extended margin of protection, select a temperature at least 10°F lower than the expected lowest ambient temperature. Inhibitor levels should be adjusted for solutions less than 25% glycol.
2. Glycol of less than 25% concentration is not recommended because of the potential for bacterial growth and loss of heat transfer efficiency.

Field Wiring Diagram

Field wiring diagram is generated for each unit and is part of the unit onboard documentation. Refer to this document for a complete explanation of the field wirings for this chillers.

Basic Control System Diagnostic

MicroTech III controller, extension modules and communication modules are equipped with two status LED (BSP and BUS) to indicate the operational status of the devices. The meaning of the two status LED is indicated below.

Controller LED

BSP LED	BUS LED	Mode
Solid Green	OFF	Application running
Solid Yellow	OFF	Application loaded but not running (*)
Solid Red	OFF	Hardware Error (*)
Flashing Yellow	OFF	Application not loaded (*)
Flashing Red	OFF	BSP Error (*)
Flashing Red/Green	OFF	Application/BSP update

(*) Contact Service.

Extension Module LED

BSP LED	BUS LED	Mode
Solid Green		BSP running
Solid Red		Hardware Error (*)
Flashing Red		BSP Error (*)
	Solid Green	Communication running, I/O working
	Solid Yellow	Communication running, parameter missing (*)
	Solid Red	Communication down (*)

(*) Contact Service.

Communication Module LED

BSP LED	Mode
Solid Green	BPS running, communication with controller
Solid Yellow	BSP running, no communication with controller (*)
Solid Red	Hardware Error (*)
Flashing Red	BSP Error (*)
Flashing Red/Green	Application/BSP update

(*) Contact Service.

BUS LED status vary depending on the module.

LON module:

BuS LED	Mode
Solid Green	Ready for Communication. (All Parameter loaded, Neuron configured). Doesn't indicate a communication with other devices.
Solid Yellow	Startup
Solid Red	No Communication to Neuron (internal error, could be solved by downloading a new LON application)
Flashing Yellow	Communication not possible to the Neuron. The Neuron must be configured and set online over the LON Tool.

Bacnet MSTP:

BuS LED	Mode
Solid Green	Ready for Communication. The BACnet Server is started. It doesn't indicate a active communication
Solid Yellow	Startup
Solid Red	BACnet Server down. Automatically a restart after 3 seconds are initiated.

Bacnet IP:

BuS LED	Mode
Solid Green	Ready for Communication. The BACnet Server is started. It doesn't indicate a active communication
Solid Yellow	Startup. The LED stays yellow until the module receives a IP Address, therefore a link must be established.
Solid Red	BACnet Server down. Automatic restart after 3 seconds is initiated.


Modbus

BuS LED	Mode
Solid Green	All Communication running
Solid Yellow	Startup, or one configured channel not communicating to the Master.
Solid Red	All configured Communications down. Means no communication to the Master. The timeout can be configured. In case that the timeout is zero the timeout is disabled.

Controller maintenance

The controller requires to maintain the installed battery. Every two years it's required to replace the battery. Battery model is: BR2032 and it is produced by many different vendors.

To replace the battery remove the plastic cover of the controller display using a screw driver as shown in the following picture:

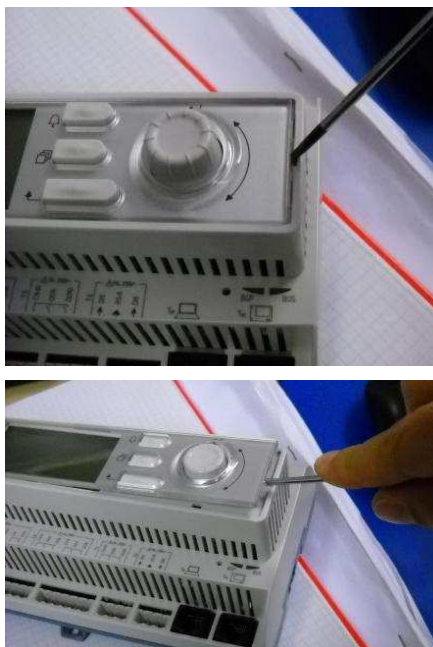

Be careful to avoid damages to the plastic cover. The new battery shall be placed in the proper battery holder which is highlighted in the following picture, respecting the polarities indicated into the holder itself.



Appendix

Definitions

Active Setpoint

The active setpoint is the setting in effect at any given moment. This variation occurs on setpoints that can be altered during normal operation. Resetting the chilled water leaving temperature setpoint by one of several methods, such as return water temperature, is an example.

Active Capacity Limit

The active setpoint is the setting in effect at any given moment. Any one of several external inputs can limit a compressor's capacity below its maximum value.

BSP

The BSP represents the operative system of the MicroTech III controller.

Dead Band

The dead band is a range of values surrounding a setpoint such that a change in the variable occurring within the dead band range causes no action from the controller. For example, if a temperature setpoint is **6.5 °C** (44°F) and it has a dead band of $\pm 1^{\circ}\text{C}$ ($\pm 2^{\circ}\text{F}$), nothing will happen until the measured temperature is less than **5.5°C** (42°F) or more than **7.5°C** (46°F).

DIN

Digital input, usually followed by a number designating the number of the input.

Error

In the context of this manual, "Error" is the difference between the actual value of a variable and the target setting or setpoint.

Evaporator Approach

The evaporator approach is calculated for each circuit. The equation is as follows:

$$\text{Evaporator Approach} = \text{LWT} - \text{Evaporator Saturated Temperature}$$

Evap Recirc Timer

A timing function, with a 30-second default, that holds off any reading of chilled water for the duration of the timing setting. This delay allows the chilled water sensors (especially water temperatures) to take a more accurate reading of the chilled water system conditions.

EXV

Electronic expansion valve, used to control the flow of refrigerant to the evaporator, controlled by the circuit microprocessor.

High Saturated Condenser – Hold Value

$$\text{High Cond Hold Value} = \text{Max Saturated Condenser Value} - \mathbf{2.7^{\circ}\text{C}} \text{ (} \mathbf{5^{\circ}\text{F}} \text{)}$$

This function prevents the compressor from loading whenever the pressure approaches within **2.7 °C** (5 °F) of the maximum discharge pressure. The purpose is to keep the compressor online during periods of possibly temporary elevated pressures.

High Saturated Condenser – Unload Value

$$\text{High Cond Unload Value} = \text{Max Saturated Condenser Value} - \mathbf{1.6^{\circ}\text{C}} \text{ (} \mathbf{3^{\circ}\text{F}} \text{)}$$

This function unloads the compressor whenever the pressure approaches within **1.6 °C** (3°F) of the maximum discharge pressure. The purpose is to keep the compressor online during periods of possibly temporary elevated pressures.

Light Load Stg Dn Point

The percent load point at which one of two operating compressors will shut off, transferring the unit load to the remaining compressor.

Load Limit

An external signal from the keypad, the BAS or a 4-20 ma signal that limits the compressor loading to a designated percent of full load. Frequently used to limit unit power input.

Load Balance

Load balance is a technique that equally distributes the total unit load among the running compressors on a unit or group of units.

Low Ambient Lockout

Prevents the unit from operating (or starting) at ambient temperatures below the setpoint.

Low Pressure Unload Setpoint

The psi evaporator pressure setting at which the controller will unload the compressor until a preset pressure is reached.

Low Pressure Hold Setpoint

The psi evaporator pressure setting at which the controller will not allow further compressor loading.

Low/High Superheat Error

The difference between actual evaporator superheat and the superheat target.

LWT

Leaving water temperature. The “water” is any fluid used in the chiller circuit.

LWT Error

Error in the controller context is the difference between the value of a variable and the setpoint. For example, if the LWT setpoint is **6.5 °C** (44°F) and the actual temperature of the water at a given moment is **7.5°C** (46°F), the LWT error is **+1°C** (+2°F).

LWT Slope

The LWT slope is an indication of the trend of the water temperature. It is calculated by taking readings of the temperature every few seconds and subtracting them from the previous value, over a rolling one minute interval.

ms

Milli-second

Maximum Saturated Condenser Temperature

The maximum saturated condenser temperature allowed is calculated based on the compressor operational envelope.

Offset

Offset is the difference between the actual value of a variable (such as temperature or pressure) and the reading shown on the microprocessor as a result of the sensor signal.

Refrigerant Saturated Temperature

Refrigerant saturated temperature is calculated from the pressure sensor readings for each circuit. The pressure is fitted to an R-134a temperature/pressure curve to determine the saturated temperature.

Soft Load

Soft Loading is a configurable function used to ramp up the unit capacity over a given time period, usually used to influence building electrical demand by gradually loading the unit.

SP

Setpoint

SSS

Solid state starter as used on screw compressors.

Suction Superheat

Suction superheat is calculated for each circuit using the following equation:

$$\text{Suction Superheat} = \text{Suction Temperature} - \text{Evaporator Saturated Temperature}$$

Stage Up/Down Accumulator

The accumulator can be thought of as a bank storing occurrences that indicate the need for an additional fan.

Stageup/Stagedown Delta-T

Staging is the act of starting or stopping a compressor or fan when another is still operating. Startup and Stop is the act of starting the first compressor or fan and stopping the last compressor or fan. The Delta-T is the “dead band” on either side of the setpoint in which no action is taken.

Stage Up Delay

The time delay from the start of the first compressor to the start of the second.

Startup Delta-T

Number of degrees above the LWT setpoint required to start the first compressor.

Stop Delta-T

Number of degrees below the LWT setpoint required for the last compressor to stop.

VDC

Volts, Direct current, sometimes noted as vdc.

The present publication is drawn up by of information only and does not constitute an offer binding upon Daikin Applied Europe S.p.A.. Daikin Applied Europe S.p.A. has compiled the content of this publication to the best of its knowledge. No express or implied warranty is given for the completeness, accuracy, reliability or fitness for particular purpose of its content, and the products and services presented therein. Specification are subject to change without prior notice. Refer to the data communicated at the time of the order. Daikin Applied Europe S.p.A. explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this publication. All content is copyrighted by Daikin Applied Europe S.p.A..

DAIKIN APPLIED EUROPE S.p.A.

Via Piani di Santa Maria, 72 - 00040 Ariccia (Roma) - Italia

Tel: (+39) 06 93 73 11 - Fax: (+39) 06 93 74 014

<http://www.daikinapplied.eu>